

Air conditioner

Installation manual

AC***RXADKG

- Thank you for purchasing this Samsung air conditioner.
- Before operating this unit, please read this manual carefully and retain it for future reference.



SAMSUNG

Contents

| | |
|--|-----------|
| Safety Information | 4 |
| Safety Information | 4 |
| Installation Procedure | 9 |
| Step 1 Choosing the installation location | 9 |
| Step 2 Fixing the outdoor unit in place | 12 |
| Step 3 Connecting the power cables, communication cable, and controllers | 13 |
| Step 4 Optional: Extending the power cable | 18 |
| Step 5 Connecting the refrigerant pipe | 20 |
| Step 6 Optional: Cutting and flaring the pipes | 21 |
| Step 7 Connecting up and removing air in the circuit | 22 |
| Step 8 Adding refrigerant (R-32) | 23 |
| Step 9 Optional: Installing DPM | 26 |
| Step 10 Performing the gas leak test | 27 |
| Step 11 Connecting the drain hose to the outdoor unit | 27 |
| Step 12 Insulating the refrigerant pipes | 28 |
| Step 13 Checking the earthing | 28 |
| Step 14 Performing final check and trial operation | 29 |
| Extra procedures | 32 |
| Pumping down refrigerant | 32 |
| Relocating the indoor and outdoor units | 32 |
| Using the stop valve | 32 |
| Maintenance procedures | 34 |
| Performing the gas leak tests for repair | 34 |
| Decommissioning | 34 |
| Appendix | 35 |
| COMMISSION DELEGATED REGULATION (EU) No 626/2011 ¹⁾ | 35 |
| Troubleshooting | 57 |
| Technical specifications | 59 |



***Correct Disposal of This Product
(Waste Electrical & Electronic Equipment)***

(Applicable in countries with separate collection systems)

This marking on the product, accessories or literature indicates that the product and its electronic accessories (e.g. charger, headset, USB cable) should not be disposed of with other household waste at the end of their working life. To prevent possible harm to the environment or human health from uncontrolled waste disposal, please separate these items from other types of waste and recycle them responsibly to promote the sustainable reuse of material resources.

Household users should contact either the retailer where they purchased this product, or their local government office, for details of where and how they can take these items for environmentally safe recycling.

Business users should contact their supplier and check the terms and conditions of the purchase contract. This product and its electronic accessories should not be mixed with other commercial wastes for disposal.

For information on Samsung's environmental commitments and product-specific regulatory obligations, e.g. REACH, visit: www.samsung.com/uk/aboutsamsung/sustainability/environment/our-commitment/data/

Safety Information

WARNING: Read This Manual

- Read and follow all safety information and instructions before installation, use, or maintenance of this appliance. Incorrect installation, use, or maintenance of this appliance can result in death, serious injury, or property damage. Keep these instructions with this appliance. This manual is subject to change. For the latest version, visit www.samsung.com.

Notices and notes

To make you aware of safety messages and highlighted information, we use the following notices and notes throughout this manual:

WARNING

Hazards or unsafe practices that may result in severe personal injury or death.

CAUTION

Hazards or unsafe practices that may result in minor personal injury or property damage.

IMPORTANT

Information of special interest

NOTE

Supplementary information that may be useful



WARNING: Low burning velocity material (This appliance is filled with R-32.)



The user and installer guides should be read carefully.



The user and installer guides should be read carefully.



The service guide should be read carefully.

WARNING

The installation and testing of this appliance must be performed by a qualified technician.

- The instructions in this manual are not intended as a substitute for proper training or adequate experience in the safe installation of the appliance.

Always install the air conditioner in compliance with current local, state, and federal safety standards.

General information

WARNING

- Carefully read the content of this manual before installing the air conditioner and store the manual in a safe place in order to be able to use it as reference after installation.
- For maximum safety, installers should always carefully read the following warnings.
- Store the operation and installation manual in a safe location and remember to hand it over to the new owner if the air conditioner is sold or transferred.
- This manual explains how to install an indoor unit with a split system with two SAMSUNG units. The use of other types of units with different control systems may damage the units and invalidate the warranty. The manufacturer shall not be responsible for damages arising from the use of non compliant units.
- The manufacturer shall not be responsible for damage originating from unauthorized changes or the improper connection of electric and requirements set forth in the "Operating limits" table, included in the manual, shall immediately invalidate the warranty.
- The air conditioner should be used only for the applications for which it has been designed: the indoor unit is not suitable to be installed in areas used for laundry.
- Do not use the units if damaged. If problems occur, switch the unit off and disconnect it from the power supply.
- In order to prevent electric shocks, fires or injuries, always stop the unit, disable the protection switch and contact SAMSUNG's technical support if the unit produces smoke, if the power cable is hot or damaged or if the unit is very noisy.
- Always remember to inspect the unit, electric connections, refrigerant tubes and protections regularly. These operations should be performed by qualified personnel only.
- The unit contains moving parts, which should always be kept out of the reach of children.
- Do not attempt to repair, move, alter or reinstall the unit. If performed by unauthorized personnel, these operations may cause electric shocks or fires.
- Do not place containers with liquids or other objects on the unit.
- All the materials used for the manufacture and packaging of the air conditioner are recyclable.
- The packing material and exhaust batteries of the remote controller(optional) must be disposed of in accordance with current laws.
- The air conditioner contains a refrigerant that has to be disposed of as special waste. At the end of its life cycle, the air conditioner must be disposed of in authorized centres or returned to the retailer so that it can be disposed of correctly and safely.
- Wear protective equipment (such as safety gloves, goggles, and headgear) during installation and maintenance works. Installation/repair technicians may be injured if protective equipment is not properly equipped.
- Do not use means to accelerate the defrost operation or to clean, other than those recommended by Samsung.
- Do not pierce or burn.
- Be aware that refrigerants may not contain an odour.
- This appliance is not intended for use by persons (including children) with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction concerning use of the appliance by a person responsible for their safety. Children should be supervised to ensure that they do not play with the appliance.
- **For use in Europe:** This appliance can be used by children aged from 8 years and above and persons with reduced physical, sensory or mental capabilities or lack of experience and knowledge if they have been given supervision or instruction concerning use of the appliance in a safe way and understand the hazards involved. Children shall not play with the appliance. Cleaning and user maintenance shall not be made by children without supervision.

Safety Information

Installing the unit

WARNING

IMPORTANT: When installing the unit, always remember to connect first the refrigerant tubes, then the electrical lines.

- Upon receipt, inspect the product to verify that it has not been damaged during transport. If the product appears damaged, DO NOT INSTALL it and immediately report the damage to the carrier or retailer (if the installer or the authorized technician has collected the material from the retailer.)
- After completing the installation, always carry out a functional test and provide the instructions on how to operate the air conditioner to the user.
- Do not use the air conditioner in environments with hazardous substances or close to equipment that release free flames to avoid the occurrence of fires, explosions or injuries.
- Our units should be installed in compliance with the spaces shown in the installation manual, to ensure accessibility from both sides and allow repairs or maintenance operations to be carried out. The unit's components should be accessible and easy to disassemble without endangering people and objects.
- For this reason, when provisions of the installation manual are not complied with, the cost required to access and repair the units (in SAFETY CONDITIONS, as set out in prevailing regulations) with harnesses, ladders, scaffolding or any other elevation system will NOT be considered part of the warranty and will be charged to the end customer.
- The outdoor unit shall be installed in an open space that is always ventilated.
- The local gas regulations shall be observed.
- To handle, purge, and dispose the refrigerant, or break into the refrigerant circuit, the worker should have a certificate from an industry-accredited authority.
- While in installation or relocation of the product, do not mix the refrigerant with other gases including air or unspecified refrigerant. Failure to do so may cause pressure increase to result in rupture or injury.
- Do not cut or burn the refrigerant container or pipings.
- Use clean parts such as manifold gauge, vacuum pump, and charging hose for the refrigerant.
- Installation must be carried out by qualified personnel for handling the refrigerant. Additionally, reference the regulations and laws.
- Be careful not to let foreign substances (lubricating oil, refrigerant, water, etc.) enter the pipings.
- When mechanical ventilation is required, ventilation openings shall be kept clear of obstruction.
- For disposal of the product, follow the local laws and regulations.
- Do not work in a confined place.
- The work area shall be blocked.
- The refrigerant pipings shall be installed in the position where there are no substances that may result in corrosion.
- The following checks shall be performed for installation:
 - The charging amount depends on the room size.
 - The ventilation devices and outlets are operating normally and are not obstructed.
 - Markings and signs on the equipment shall be visible and legible.
- Upon leakage of the refrigerant, ventilate the room. When the leaked refrigerant is exposed to flame, it may cause generation of toxic gases.
- Make sure that the work area is safe from flammable substances.
- To purge air in the refrigerant, be sure to use a vacuum pump.
- Note that the refrigerant has no odour.
- The units are not explosion proof so they must be installed with no risk of explosion.
- This product contains fluorinated gases that contribute to global greenhouse effect. Accordingly, do not vent gases into the atmosphere.
- For installation with handling the refrigerant(R-32), use dedicated tools and piping materials. Working pressure of R-32 is higher than R410A, So failure to use the dedicated tools and piping materials may cause rupture or injury. Furthermore, it may cause serious accidents such as water leakage, electric shock or fire.
- Servicing shall be performed as recommended by the manufacturer. In case other skilled persons are joined for servicing, it shall be carried out under supervision of the person who is competent in handling flammable refrigerants.

- For servicing the units containing flammable refrigerants, safety checks are required to minimise the risk of ignition.
- Servicing shall be performed following the controlled procedure to minimize the risk of flammable refrigerant or gases.
- Do not install where there is a risk of combustible gas leakage.
- Do not place heat sources.
- Be cautious not to generate a spark as follows:
 - Do not remove the fuses with power on.
 - Do not disconnect the power plug from the wall outlet with power on.
 - It is recommended to locate the outlet in a high position. Place the cords so that they are not tangled.
- If the indoor unit is not R-32 compatible, an error signal appears and the unit will not operate.
- After installation, check for leakage. Toxic gas may be generated and if it comes into contact with an ignition source such as fan heater, stove, and cooker, cylinders, make sure that only the refrigerant recovery cylinders are used.
- Never directly touch any accidental leaking refrigerant. It could result in severe wounds caused by frostbite.
- The work area should be checked to ensure that there are no flammable hazards or ignition risks. The "No Smoking" sign shall be attached.
- Under no circumstances shall potential sources of ignition be used while in detection of leakage.
- Make sure that the seals or sealing materials have not degraded.
- Safe parts are the ones with which the worker can work in a flammable atmosphere. Other parts may result in ignition due to leakage.
- Replace components only with parts specified by Samsung. Other parts may result in the ignition of refrigerant in the atmosphere from a leak.

Area ventilation

- Make sure that the work area is well ventilated before performing a hot work.
- Ventilation shall be made even during the work.
- The ventilation should safely disperse any released gases and preferably expel them into the atmosphere.
- Ventilation shall be made even during the work.

Leakage detection methods

- The leakage detector shall be calibrated in a refrigerant-free area.
- Make sure that the detector is not a potential source of ignition.
- The leakage detector shall be set to the LFL (lower flammability limit).
- The use of detergents containing chlorine shall be avoided for cleaning because the chlorine may react with the refrigerant and corrode the pipings.
- If leakage is suspected, naked flames shall be removed.
- If a leakage is found while in brazing, the entire refrigerant shall be recovered from the product or isolated (e.g. using shut-off valves). It shall not be directly released to the environment. Oxygen free nitrogen (OFN) shall be used for purging the system before and during the brazing process.
- The work area shall be checked with an appropriate refrigerant detector before and during work.
- Ensure that the leakage detector is appropriate for use with flammable refrigerants.

Preparation of fire extinguisher

- If a hot work is to be done, an appropriate fire extinguishing equipment should have been available.
- A dry powder or CO₂ fire extinguisher shall be equipped near the charging area.

Ignition sources free

- Make sure to store the units in a place without continuously operating ignition sources (for example, open flames, an operating gas appliance or an operating electric heater).
- The service engineers shall not use any ignition sources with the risk of fire or explosion.
- Potential ignition sources shall be kept away from the work area where the flammable refrigerant can possibly be released to the surrounding.

Safety Information

Labelling

- The parts shall be labelled to ensure that they have been decommissioned and emptied of refrigerant.
- The labels shall be dated.
- Make sure that the labels are affixed on the system to notify it contains flammable refrigerant.

Recovery

- When removing refrigerant from the system for servicing or decommissioning, it is recommended to remove the entire refrigerant.
- When transferring refrigerant into cylinders, make sure that only the refrigerant recovery cylinders are used.
- All cylinders used for the recovered refrigerant shall be labelled.
- Cylinders shall be equipped with pressure relief valves and shut-off valves in a proper order.
- Empty recovery cylinders shall be evacuated and cooled before recovery.
- The recovery system shall operate normally according to the specified instructions and shall be suitable for refrigerant recovery.
- In addition, the calibration scales shall operate normally.
- Hoses shall be equipped with leak-free disconnect couplings.
- Before starting the recovery, check for the status of the recovery system and sealing state. Consult with the manufacturer if suspected.
- The recovered refrigerant shall be returned to the supplier in the correct recovery cylinders with the Waste Transfer Note attached.
- Do not mix refrigerants in the recovery units or cylinders.
- If compressors or compressor oils are to be removed, make sure that they have been evacuated to the acceptable level to ensure that flammable refrigerant does not remain in the lubricant.
- The evacuation process shall be performed before sending the compressor to the suppliers.
- Only the electrical heating to the compressor body is allowed to accelerate the process.
- Oil shall be drained safely from the system.

- For installation with handling the refrigerant (R-32), use dedicated tools and piping materials. Because the pressure of the refrigerant, R-32 is approximately 1.6 times higher than that of R-22, failure to use the dedicated tools and piping materials may cause rupture or injury. Furthermore, it may cause serious accidents such as water leakage, electric shock, or fire.
- Never install a motor-driven equipment to prevent ignition.

Power supply line, fuse or circuit breaker

WARNING

- Always make sure that the power supply is compliant with current safety standards. Always install the air conditioner in compliance with current local safety standards.
- Always verify that a suitable earthing connection is available.
- Verify that the voltage and frequency of the power supply comply with the specifications and that the installed power is sufficient to ensure the operation of any other domestic appliance connected to the same electric lines.
- Always verify that the cut-off and protection switches are suitably dimensioned.
- Verify that the air conditioner is connected to the power supply in accordance with the instructions provided in the wiring diagram included in the manual.
- Always verify that electric connections (cable entry, section of leads, protections...) are compliant with the electric specifications and with the instructions provided in the wiring scheme. Always verify that all connections comply with the standards applicable to the installation of air conditioners.
- Devices disconnected from the power supply should be completely disconnected in the condition of overvoltage category.
- Be sure not to perform power cable modification, extension wiring, and multiple wire connection.
 - It may cause electric shock or fire due to poor connection, poor insulation, or current limit override.
 - When extension wiring is required due to power line damage, refer to "Step 4 Optional: Extending the power cable" in the installation manual.

Installation Procedure

Step 1 Choosing the installation location

WARNING

- If appliances contain R-32 refrigerant, then the floor area of the room in which the appliances are installed, operated and stored must be larger than the minimum floor area defined in table below A (m²).

| Minimum required room area (A, m ²) | | | |
|---|----------------------|-------------------|---------------------|
| m (kg) | Ceiling-mounted type | Wall-mounted type | Floor-standing type |
| ≤1.842 | No requirement | | |
| 1.843 | 3.64 | 4.45 | 28.9 |
| 1.9 | 3.75 | 4.58 | 30.7 |
| 2.0 | 3.95 | 4.83 | 34.0 |
| 2.2 | 4.34 | 5.31 | 41.2 |
| 2.4 | 4.74 | 5.79 | 49.0 |
| 2.6 | 5.13 | 6.39 | 57.5 |
| 2.8 | 5.53 | 7.41 | 66.7 |
| 3.0 | 5.92 | 8.51 | 76.6 |
| 3.2 | 6.48 | 9.68 | 87.2 |
| 3.4 | 7.32 | 10.9 | 98.4 |
| 3.6 | 8.20 | 12.3 | 110 |
| 3.8 | 9.14 | 13.7 | 123 |
| 4.0 | 10.1 | 15.1 | 136 |
| 4.2 | 11.2 | 16.7 | 150 |
| 4.4 | 12.3 | 18.3 | 165 |
| 4.6 | 13.4 | 20.0 | 180 |
| 4.8 | 14.6 | 21.8 | 196 |
| 5.0 | 15.8 | 23.6 | 213 |
| 5.4 | 18.6 | 27.6 | 248 |
| 5.6 | 20.0 | 29.7 | 267 |
| 5.8 | 21.5 | 31.8 | 286 |
| 6.0 | 23.0 | 34.0 | 306 |

• m : Total refrigerant charge in the system
 • A : Minimum required room area


- IMPORTANT: it's mandatory to consider either the table 1 or taking into consideration the local law regarding the minimum living space of the premises.
- Minimum installation height of indoor unit is 0.6 m for floor mounted, 1.8 m for wall, 2.2 m for ceiling.

Installation location requirements

- The outdoor unit shall be installed in an open space that is always ventilated.
- The local gas regulations shall be observed.
- For installation inside a building (this applies either to indoor or outdoor units installed inside) a minimum room floor area of space conditioned is mandatory according to EN378-1:2017 (see the reference table into the indoor unit installation manual).
- To handle, purge, and dispose the refrigerant, or break into the refrigerant circuit, the worker should have a certificate from an industry-accredited authority.
- Do not install the air conditioner in following areas.
 - The place where there is mineral oil or arsenic acid. Resin parts flame and the accessories may drop or water may leak. The capacity of the heat exchanger may reduce or the air conditioner may be out of order.
 - The place where corrosive gas such as sulfurous acid gas generates from the vent pipe or air outlet. The copper pipe or connection pipe may corrode and refrigerant may leak.
 - The place where there is a machine that generates electromagnetic waves. The air conditioner may not operate normally due to control system.
 - The place where there is a danger of existing combustible gas, carbon fiber or flammable dust.
 - The place where animals may urinate on the product. Ammonia may be generated.
 - The place where thinner or gasoline is handled. Gas may leak and it may cause fire.
 - The place where is close to heat sources
- Do not use the indoor unit for preservation of food items, plants, equipment, and art works. This may cause deterioration of their quality.
- Do not install the indoor unit if it has any drainage problem.
- Do not place the outdoor unit on its side or upside down. Failing to do so may cause the compressor lubrication oil to run into the cooling circuit and lead to a serious damage to the unit.
- Install the unit in a well-ventilated location away from direct sunlight or strong winds.
- Install the unit in a location that would not obstruct any passageways or thoroughfares.
- Install the unit in a location that would not inconvenience or disturb your neighbors, as they could be affected by the noise or the airflow coming from the unit.

Installation Procedure


- Install the unit in a location where the pipes and the cables can be easily connected to the indoor unit.
- Install the unit on a flat, stable surface that can withstand the weight of the unit. Otherwise, the unit can generate noise and vibration during operation.
- Install the unit so that the air flow is directed towards the open area.
- Maintain sufficient clearance around the outdoor unit, especially from a radio, computer, stereo system, etc.

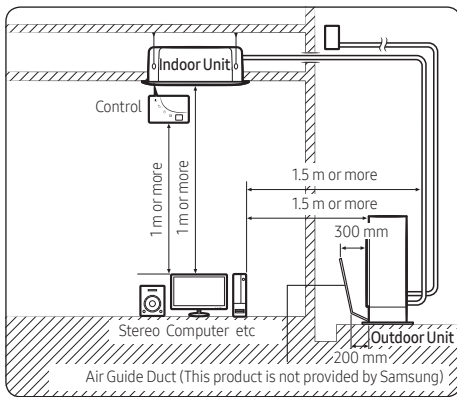

- Install the unit at a height where its base can be firmly fixed in place.
- Make sure that the water dripping from the drain hose runs away correctly and safely.

⚠ CAUTION

- This device must be installed according to the national electrical rules.
- If your outdoor unit exceeds a net weight of 60 kg, do not install it on a suspended wall, but stand it on a floor.
- When installing the outdoor unit at the seaside, an additional protective coating (third party) may be required, make sure that it is not directly exposed to sea breeze. If you cannot find an adequate place free from direct sea breeze, construct a protection wall or a protective fence.
 - Install the outdoor unit in a place (such as near buildings etc.) where it can be prevented from sea breeze. Failure to do so may cause a damage to the outdoor unit.

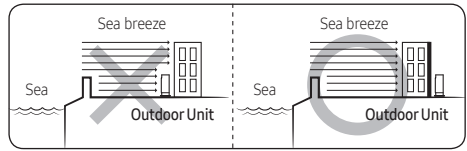

- If you cannot avoid installing the outdoor unit at the seaside, construct a protection wall around to block the sea breeze.
- Construct a protection wall with a solid material such as concrete to block the sea breeze. Make sure that the height and the width of the wall are 1.5 times larger than the size of the outdoor unit. Also, secure a space larger than 700 mm between the protection wall and the outdoor unit for exhausted air to ventilate.



⚠ CAUTION


- Depending on the condition of power supply, unstable power or voltage may cause malfunction of the parts or control system. (At the ship or places using power supply from electric generator...etc)
- Install the unit in a place where water can drain smoothly.
- If you have any difficulty finding installation location as prescribed above, contact your manufacturer for details.
- Be sure to clean the heat exchanger and base plate of the outdoor unit regularly from any collected sand and salt. Touch up the additional protective coating (third party) if needed, at least once in a year or according to the third party's product requirements.
- Check the condition of the product periodically.
 - Check the installation site every 3 months and perform anti-corrosion treatment such as R-Pro supplied by SAMSUNG (Code : MOK-220SA) or commercial water repellent grease and wax, etc., based on the product condition.
 - When the product is to be shut down for a long period of time, such as off-peak hours, take appropriate measures like covering the product.
- If the product installed within 500m of seashore, special anti-corrosion treatment is required.
 - * Please contact your local SAMSUNG representative for further details.

Outdoor unit dimensions

(Unit: mm)


A Type

AC026RXADKG/AC035RXADKG

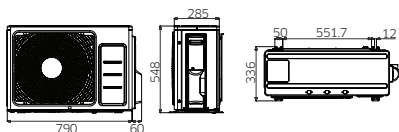


B Type

AC052RXADKG

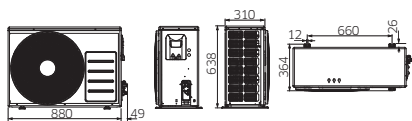

C Type



AC071RXADKG

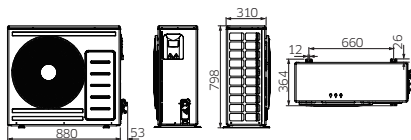

Minimum clearances for the outdoor unit






When installing 1 outdoor unit

(Unit: mm)

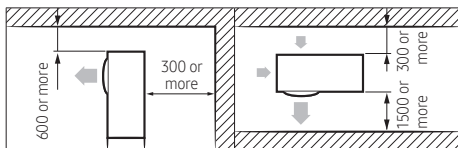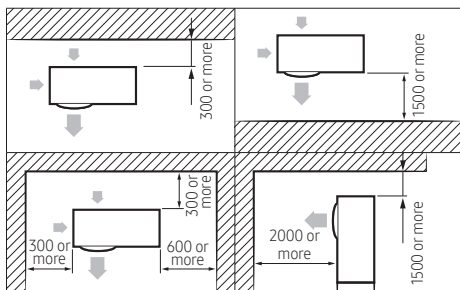

When installing more than 1 outdoor unit

(Unit: mm)

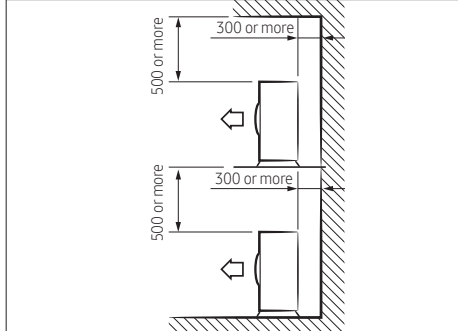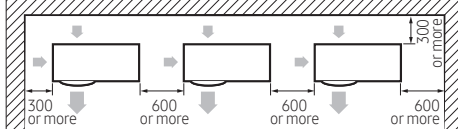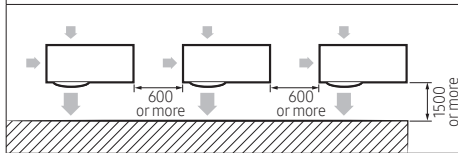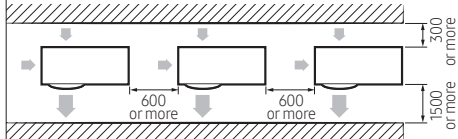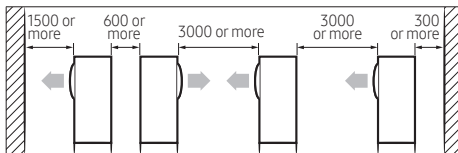


Installation Procedure

⚠ CAUTION

- The outdoor unit must be installed according to the specified distances in order to permit accessibility from each side, to guarantee correct operation, maintenance, and repair of the unit.
- The components of the outdoor unit must be reachable and removable under safe conditions for people and the unit.

⚠ WARNING


- Should adopt bar type louver. Don't use a type of rain resistance louver.

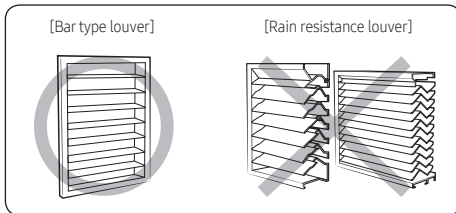

- Louver specifications.
 - Angle criteria : less than 20°
 - Opening ratio criteria : greater than 80%

Moving the outdoor unit with wire rope



- Before carrying the outdoor unit, fasten two wire ropes of 8 m or longer, as shown in the figure.
- To prevent damages or scratches effectively, insert a piece of cloth between the outdoor unit and the ropes.
- Move the outdoor unit.

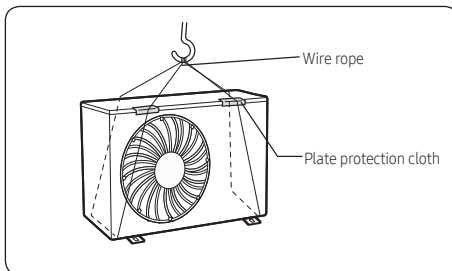

Step 2 Fixing the outdoor unit in place


Install the outdoor unit on a rigid and stable base to prevent disturbance from any noise caused by vibration. When installing the unit at a height or in a location exposed to strong winds, fix the unit securely to a support (i.e., a wall or a ground).

Fix the outdoor unit with anchor bolts. Make sure that the anchor bolts are 20 mm or higher from the base surface.

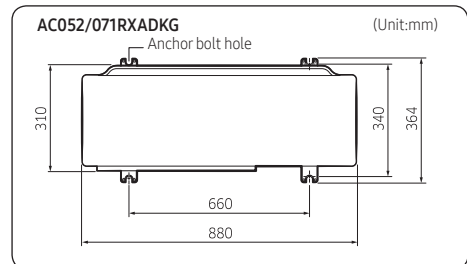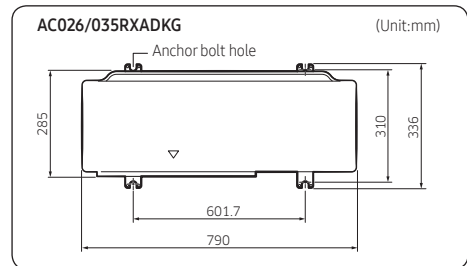


⚠ CAUTION

- Install a drain outlet at the lowest end around the base for outdoor unit drainage
- When installing the outdoor unit on the roof, waterproof the unit and check the ceiling strength.

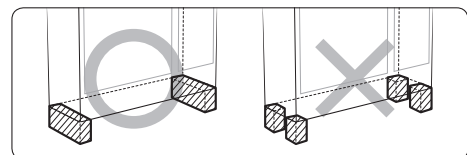

- Make sure that the wall can support the weights of the rack and the outdoor unit.
- Install the rack close to the column as much as possible.

Optional: Fixing the outdoor unit to a wall with a rack

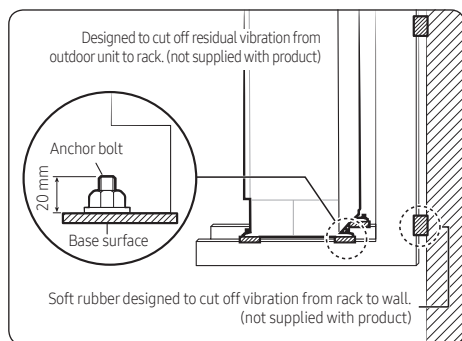

- Install a proper grommet in order to reduce noise and residual vibration transferred by the outdoor unit towards the wall.

⚠ CAUTION

- When installing an air guide duct, be sure to check the following:
 - The screws do not damage the copper pipe.
 - The air guide duct is fixed firmly on the guard fan.

Step 3 Connecting the power cables, communication cable, and controllers

You must connect the following three electrical cables to the outdoor unit:

- The main power cable between the auxiliary circuit breaker and the outdoor unit.
- The outdoor-to-indoor power cable between the outdoor unit and the indoor unit.
- The communication cable between the outdoor unit and the indoor unit.

⚠ CAUTION


- During installation, make first the refrigerant connections and then the electrical connections. If the unit is uninstalled, first disconnect the electrical cables and then the refrigerant connections.
- Connect the air conditioner to the earthing system before making the electrical connections.

📖 NOTE

- Especially, if your outdoor unit is the one designed for Russian and European markets, consult the supply authority, if necessary, to estimate and reduce the supply system impedance before installation.

Air conditioning system examples

When using earth leakage circuit breaker (ELCB) for a single phase

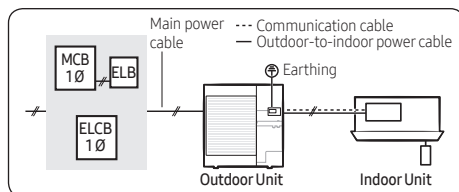


⚠ CAUTION

- Make sure to install an ELCB (RCD or RCCB) or ELB and MCB combination, according local regulations.
- For the product that uses the R-32 refrigerant, be cautious not to generate any sparks near the product

Installation Procedure

Connecting the main power cable


When using ELB for 1 phase

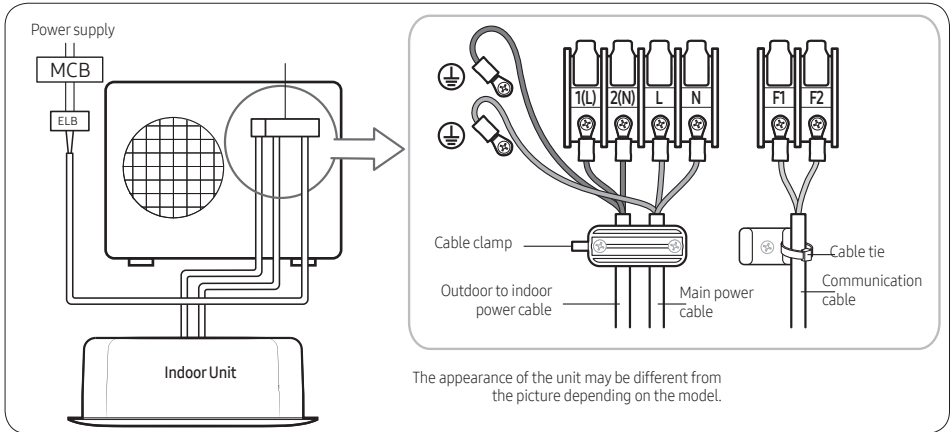

⚠ CAUTION

- You should connect the power cable into the power cable terminal and fasten it with a clamp.
- The unbalanced power must be maintained within 2% of supply rating.
If the power is unbalanced greatly, it may shorten the life of the condenser. If the unbalanced power is exceeded over 4% of supply rating, the indoor unit is protected, stopped and the error mode indicates.
- To protect the product from water and possible shock, you should keep the power cables and the communication cable of the indoor and outdoor units within ducts. (with appropriate IP rating and material selection for your application)
- Ensure that main supply connection is made through a switch that disconnects all poles, with contact gap of at least 3 mm.
- Devices disconnected from the power supply should be completely disconnected in the condition of overvoltage category.
- Keep distances of 50 mm or more between power cable and communication cable. If the distance of 50mm or more cannot be kept, a double shielded cable (FROHH2R or LiYCY type) must be used, connected to earth on a single side.

Main power terminal block specifications

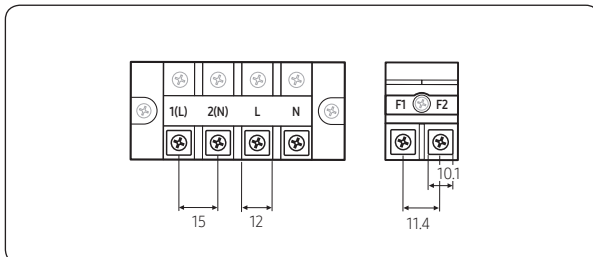

Main power cable specifications

The power cable is not supplied with air conditioner.

- Select the power supply cable in accordance with relevant local and national regulations.
- Wire size must comply with the applicable local and national code.
- Specifications for local wiring power cord and branch wiring are in compliance with local cord.

| Type | Model | | Outdoor unit | | | | Input current (Amperes) | | | | Power supply | |
|-------------|-------------|--------------|--------------|---------------|-------|--------------|-------------------------|-------------|-------|------|--------------|---------|
| | Indoor unit | Outdoor unit | Rated | Voltage range | | Outdoor unit | | Indoor unit | Total | MCA | MFA | |
| | | | | Hz | Volts | Min. | Max. | | | | | Cooling |
| A | AC026RN1DKG | AC026RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.0 | 11.0 | 11.0 | 12.5 |
| | AC026RNNDKG | AC026RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.0 | 11.0 | 11.0 | 12.5 |
| | AC026RNLDKG | AC026RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.7 | 11.7 | 11.7 | 12.9 |
| | AC026BNLDKG | AC026RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.7 | 11.7 | 11.7 | 12.9 |
| | AC026RNADKG | AC026RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.6 | 11.6 | 11.6 | 12.8 |
| | AC026RNJDKG | AC026RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.0 | 11.0 | 11.0 | 12.5 |
| | AC026TNXDKG | AC026RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.2 | 11.2 | 11.2 | 12.5 |
| | AC035RN1DKG | AC035RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.0 | 11.0 | 11.0 | 12.5 |
| | AC035RNNDKG | AC035RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.0 | 11.0 | 11.0 | 12.5 |
| | AC035RNMDKG | AC035RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 2.5 | 12.5 | 12.5 | 13.8 |
| | AC035RNLDKG | AC035RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.7 | 11.7 | 11.7 | 12.9 |
| | AC035BNLDKG | AC035RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.7 | 11.7 | 11.7 | 12.9 |
| | AC035RNADKG | AC035RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.6 | 11.6 | 11.6 | 12.8 |
| | AC035RNJDKG | AC035RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.0 | 11.0 | 11.0 | 12.5 |
| AC035TNXDKG | AC035RXADKG | 50 | 220 to 240 | 198 | 264 | 10.0 | 10.0 | 1.2 | 11.2 | 11.2 | 12.5 | |
| B | AC052RN4DKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.0 | 17.5 | 17.5 | 20.6 |
| | AC052RNNDKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.0 | 17.5 | 17.5 | 20.6 |
| | AC052RNMDKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 2.5 | 19.0 | 19.0 | 20.9 |
| | AC052RNLDKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.7 | 18.2 | 18.2 | 20.6 |
| | AC052BNLDKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.7 | 18.2 | 18.2 | 20.6 |
| | AC052RNCDKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.0 | 17.5 | 17.5 | 20.6 |
| | AC052RNADKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.6 | 18.1 | 18.1 | 20.6 |
| | AC052RNJDKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.0 | 17.5 | 17.5 | 20.6 |
| | AC052TNXDKG | AC052RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.2 | 17.7 | 17.7 | 20.6 |


Installation Procedure

| Type | Model | | Outdoor unit | | | | Input current (Amperes) | | | | Power supply | |
|------|-------------|--------------|--------------|---------------|------|--------------|-------------------------|-------------|-------|------|--------------|---------|
| | Indoor unit | Outdoor unit | Rated | Voltage range | | Outdoor unit | | Indoor unit | Total | MCA | MFA | |
| | | | Hz | Volts | Min. | Max. | Cooling | | | | | Heating |
| C | AC071RN4DKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.0 | 17.5 | 17.5 | 20.6 |
| | AC071RNNDKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.0 | 17.5 | 17.5 | 20.6 |
| | AC071RN4PKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.5 | 18.0 | 18.0 | 20.6 |
| | AC071RNMDKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 2.5 | 19.0 | 19.0 | 20.9 |
| | AC071RNLDKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.7 | 18.2 | 18.2 | 20.6 |
| | AC071BNLDKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.7 | 18.2 | 18.2 | 20.6 |
| | AC071RNCDKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.0 | 17.5 | 17.5 | 20.6 |
| | AC071RNADKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.6 | 18.1 | 18.1 | 20.6 |
| | AC071TNXDKG | AC071RXADKG | 50 | 220 to 240 | 198 | 264 | 16.5 | 16.5 | 1.2 | 17.7 | 17.7 | 20.6 |

NOTE

- 1 Voltage range
 - Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits
- 2 Maximum allowable voltage variation between phases is 2%.
- 3 Wire size & type must comply with the applicable local and national code.
 - Wire size: Based on the value of MCA.
 - Wire type: 60245 IEC57(IEC) or H05RN-F(CENELEC) grade or more.
- 4 MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).
- 5 MCA represents maximum input current.
 - MFA represents capacity which may accept MCA
 - Abbreviations
MCA: Min. Circuit Amps. (A)
MFA: Max. Fuse Amps. (A)

Connecting the outdoor-to-indoor power cable and the communication cable

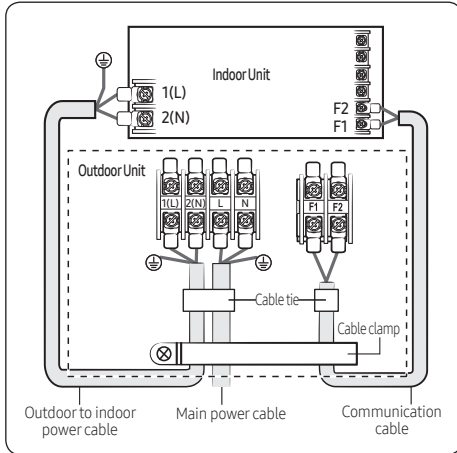


NOTE

- Lay the electrical wiring so that the front cover does not rise up when doing wiring work and attach the front cover securely.
- Ground wire for the indoor unit and outdoor unit connection cable must be clamped to a soft copper tin-plated eyelet terminal with M4 screw hole (NOT SUPPLIED WITH UNIT ACCESSORIES).

Outdoor-to-indoor power terminal specifications

- Connect the cables to the terminal board using the compressed ring terminal.
- Cover a solderless ring terminal and a connector part of the power cable and then connect it.

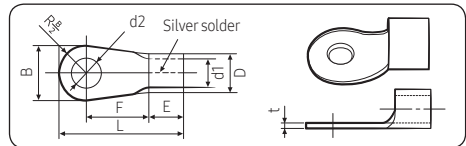

| Nominal dimensions for cable (mm ²) | Nominal dimensions for screw (mm) | B | | D | | d1 | | E | F | L | d2 | | t |
|---|-----------------------------------|-------------------------|----------------|-------------------------|----------------|-------------------------|----------------|------|----|----|-------------------------|----------------|------|
| | | Standard dimension (mm) | Allowance (mm) | Standard dimension (mm) | Allowance (mm) | Standard dimension (mm) | Allowance (mm) | | | | Standard dimension (mm) | Allowance (mm) | |
| 4/6 | 4 | 9.5 | ±0.2 | 5.6 | +0.3 -0.2 | 3.4 | ±0.2 | 6 | 5 | 20 | 4.3 | +0.2 0 | 0.9 |
| | 8 | 15 | | | | | | | 9 | | 28.5 | | |
| 10 | 8 | 15 | ±0.2 | 7.1 | +0.3 -0.2 | 4.5 | ±0.2 | 7.9 | 9 | 30 | 8.4 | +0.4 0 | 1.15 |
| 16 | 8 | 16 | ±0.2 | 9 | +0.3 -0.2 | 5.8 | ±0.2 | 9.5 | 13 | 33 | 8.4 | +0.4 0 | 1.45 |
| 25 | 8 | 12 | ±0.3 | 11.5 | +0.5 -0.2 | 7.7 | ±0.2 | 11 | 15 | 34 | 8.4 | +0.4 0 | 1.7 |
| | 8 | 16.5 | | | | | | | 13 | | 8.4 | | |
| 35 | 8 | 16 | ±0.3 | 13.3 | +0.5 -0.2 | 9.4 | ±0.2 | 12.5 | 13 | 38 | 8.4 | +0.4 0 | 1.8 |
| | 8 | 22 | | | | | | | 13 | | 43 | | |
| 50 | 8 | 22 | ±0.3 | 13.5 | +0.5 -0.2 | 11.4 | ±0.3 | 17.5 | 14 | 50 | 8.4 | +0.4 0 | 1.8 |
| 70 | 8 | 24 | ±0.4 | 17.5 | +0.5 -0.4 | 13.3 | ±0.4 | 18.5 | 20 | 51 | 8.4 | +0.4 0 | 2.0 |

- Connect the rated cables only.
- Connect using a driver which is able to apply the rated torque to the screws.
- If the terminal is loose, fire may occur caused by arc. If the terminal is connected too firmly, the terminal may be damaged.

Installation Procedure

| Tightening torque (kgf • cm) | |
|------------------------------|--------------|
| M4 | 12.0 to 18.0 |
| M5 | 20.0 to 30.0 |

- $1\text{N} \cdot \text{m} = 10 \text{ kgf} \cdot \text{cm}$


⚠ CAUTION

- When connecting cables, you can connect the cables to the electrical part or connect them through the holes below depending on the spot.
- Connect the communication cable between the indoor and outdoor units through a conduit to protect against external forces, and feed the conduit through the wall together with refrigerant piping.
- Remove all burrs at the edge of the knock-out hole and secure the cable to the outdoor knock-out using lining and bushing with an electrical insulation such as rubber and so on.
- Must keep the cable in a protection tube.
- Keep distances of 50mm or more between power cable and communication cable.
- When the cables are connected through the hole, remove the knock-out piece.

Outdoor-to-indoor power and communication cables specifications

| Indoor power supply | | |
|--------------------------------|-------------|---------------------------------------|
| Power supply | Max/Min (V) | Indoor power cable |
| 1Φ, 220-240V, 50 Hz | ±10% | 0.75 to 1.5 mm ² , 3 wires |
| Communication cable | | |
| 0.75 mm ² , 2 wires | | |

- Power supply cords of parts of appliances for outdoor use shall not be lighter than polychloroprene sheathed flexible cord. (Code designation IEC:60245 IEC 57 / CENELEC: H05RN-F or IEC:60245 IEC 66 / CENELEC: H07RN-F)
- When installing the indoor unit in a computer room or net work room, use the double shielded (tape aluminium / polyester braid + copper) cable of FROHH2R or LiYCY type.




Step 4 Optional: Extending the power cable

- 1 Prepare the following tools.

| Tools | Spec | Shape |
|------------------------|--------------------|-------|
| Crimping pliers | MH-14 | |
| Connection sleeve (mm) | 20 x Ø6.5 (H x OD) | |
| Insulation tape | Width 19 mm | |
| Contraction tube (mm) | 70 x Ø8.0 (L x OD) | |


- 2 As shown in the figure, peel off the shields from the rubber and wire of the power cable.
 - Peel off 20 mm of cable shields from the pre-installed tube.

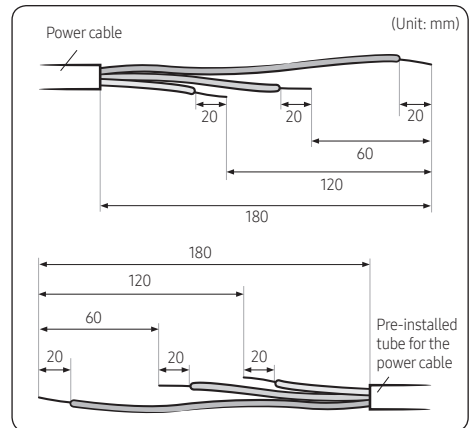

⚠ CAUTION


- For information about the power cable specifications for indoor and outdoor units, refer to the installation manual.
- After peeling off cable wires from the pre-installed tube, insert a contraction tube.

- 3 Insert both sides of core wire of the power cable into the connection sleeve.
- **Method 1:** Push the core wire into the sleeve from both sides.
 - **Method 2:** Twist the wire cores together and push it into the sleeve.

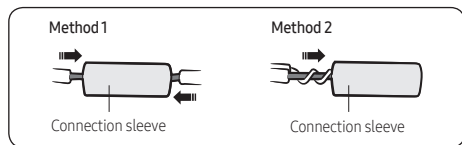


CAUTION


- If cable wires are connected without using connecting sleeves, their contact area becomes reduced, or corrosion develops on the outer surfaces of the wires (copper wires) over a long time. This may cause an increase of resistance (reduction of passing current) and consequently may result in a fire.
- 4 Using a crimping tool, compress the two points and flip it over and compress another two points in the same location.
- The compression dimension should be 8.0.

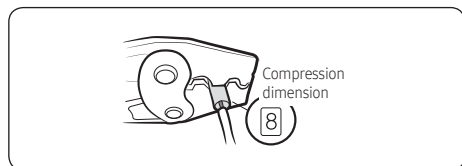


- After compressing it, pull both sides of the wire to make sure it is firmly pressed.

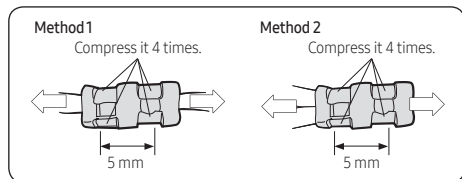


- 5 Apply heat to the contraction tube to contract it.

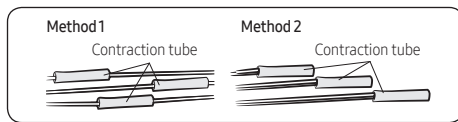

- 6 Wrap it with the insulation tape twice or more and position your contraction tube in the middle of the insulation tape.

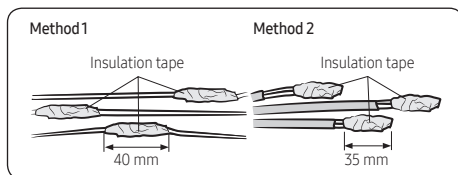

- 7 After tube contraction work is completed, wrap it with the insulation tape to finish. Three or more layers of insulation are required.




CAUTION

- Make sure that the connection parts are not exposed to outside.
- Be sure to use insulation tape and a contraction tube made of approved reinforced insulating materials that have the same level of withstand voltage with the power cable. (Comply with the local regulations on extensions.)

WARNING

- In case of extending the electric wire, please DO NOT use a round-shaped Pressing socket.
 - Incomplete wire connections can cause electric shock or a fire.

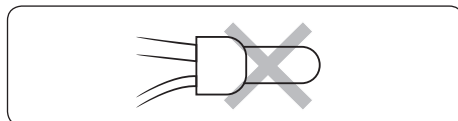


Installation Procedure

Step 5 Connecting the refrigerant pipe

| Items | Maximum allowable length | | | |
|--|----------------------------|-------------|-------------|------------------|
| | Single installation | | | DPM installation |
| Applicable outdoor unit models | AC026RXADKG AC035RXADKG | AC052RXADKG | AC071RXADKG | AC071RXADKG |
| Total pipe length ($L_1+L_2+L_3$) | - | - | - | 50m |
| Main pipe (L_1) | 20m | 30m | 50m | 30m |
| Max. distance among indoor units (D) | - | - | - | 10m |
| Max. length after branch | - | - | - | 15m |
| Max. height difference between outdoor and indoor units (h_1) | 15m | 20m | 30m | ± 30 m |
| Max. height difference among indoor units (h_2) | - | - | - | ± 0.5 m |
| Max Pipe length difference among indoor units after branch (L_2-L_3) | - | - | - | ± 5 m |

* "n" means the number of indoor unit connection of DPM.

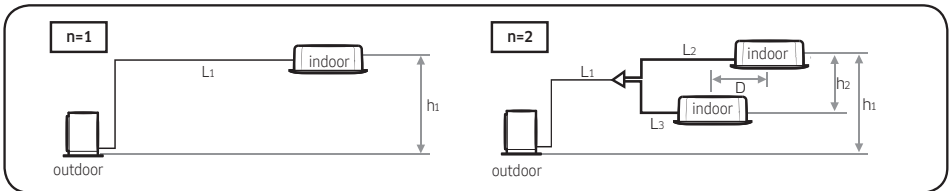

* Use a joint kit that is only for DPM.


- Temper grade and minimum thickness of the refrigerant pipe

| Outer diameter [mm] | Minimum thickness [mm] | Temper grade |
|---------------------|------------------------|-------------------------|
| $\phi 6.35$ | 0.7 | C1220T-O |
| $\phi 9.52$ | 0.7 | |
| $\phi 12.70$ | 0.8 | |
| $\phi 15.88$ | 1.0 | |
| $\phi 15.88$ | 0.8 | C1220T-1/2H OR C1220T-H |
| $\phi 19.05$ | 0.9 | |
| $\phi 22.23$ | 0.9 | |

- The material specification (thickness) of the refrigerant pipes must be in accordance with EU and/or local legislation and standards.

⚠ CAUTION

- Be sure to use C1220T-1/2H (Semi-hard) pipe for more than Ø19.05 mm. If you use C1220T-O (Soft) pipe for Ø19.05 mm, the pipe may burst open, which can result in an injury.

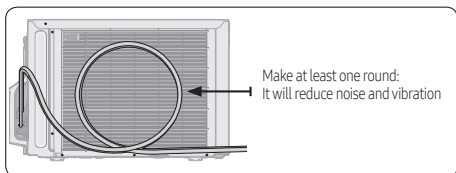


- The appearance of the unit may be different from the diagram depending on the model.

⚠ CAUTION


- After connecting the pipes with knock-out treatment, plug the space around the pipes.
- After connecting the pipes, proceed exactly as directed in the guide to prevent interference with the internal parts.
- Tighten the nuts to the specified torques. If overtightened, the nuts could be broken so refrigerant may leak.
- Protect or enclose refrigerant tubing to avoid mechanical damage.

Step 6 Optional: Cutting and flaring the pipes

- 1 Make sure that you have the required tools available. (pipe cutter, reamer, flaring tool, and pipe holder)
- 2 If you wish to shorten the pipes, cut it with a pipe cutter, taking care to ensure that the cut edge remains at a 90° angle with the side of the pipe. Refer to the illustrations below for examples of edges cut correctly and incorrectly.

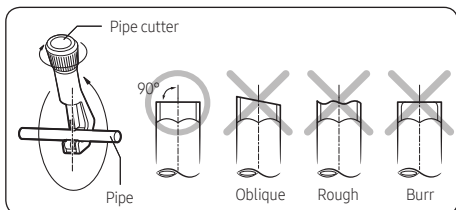


- 3 To prevent any gas from leaking out, remove all burrs at the cut edge of the pipe, using a reamer.
- 4 Slide a flare nut on to the pipe and modify the flare.

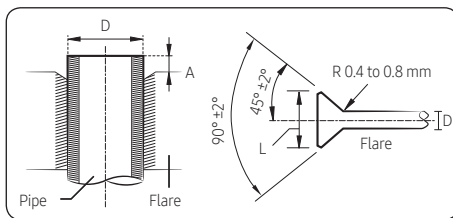

| Outer diameter (D) | Depth (A) | Flare dimension (L) |
|--------------------|------------|---------------------|
| ø6.35 mm | 14 to 18 | 8.7 to 9.1 mm |
| ø9.52 mm | 34 to 42 | 12.8 to 13.2 mm |
| ø12.70 mm | 49 to 61 | 16.2 to 16.6 mm |
| ø15.88 mm | 68 to 82 | 19.3 to 19.7 mm |
| ø19.05 mm | 100 to 120 | 23.6 to 24.0 mm |

- 1 N·m = 10 kgf·cm
- 5 Check that the flaring is correct, referring to the illustrations below for examples of incorrect flaring.

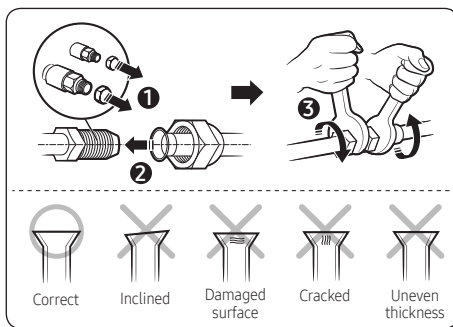

⚠ CAUTION


- Keep the piping length at a minimum to minimize the additional refrigerant charge due to piping extension.
- When connecting the pipes, make sure that surrounding objects do not interfere with or contact them to prevent refrigerant leakage due to physical damage.
- Make sure that the spaces where the refrigerant pipes are installed comply with national gas regulations.

Installation Procedure

- Be sure to perform works such as additional refrigerant charging and pipe welding under the conditions of good ventilation.
- Be sure to perform welding and piping works for mechanical connections under the conditions that the refrigerant does not circulate.
- When reconnecting the pipes, make sure to perform flared-jointing newly to prevent refrigerant leakage.
- When working on the refrigerant pipes and the flexible refrigerant connectors, be careful that they are not damaged physically by surrounding objects.
- For installation with handling the R-32 refrigerant, use the special tools for the R32 refrigerant (manifold gauge, vacuum pump, charging hose, etc.).
- During tests never pressurize the appliances with a pressure higher than the maximum allowable pressure (as indicated on the nameplate of the unit).
- Never directly touch any accidental leaking refrigerant. This could result in severe wounds caused by frostbite.
- Never install a dryer to this unit in order to guarantee its lifetime.
- If the pipes require brazing ensure that OFN (Oxygen Free Nitrogen) is flowing through the system.
- Nitrogen blowing pressure range is 0.02 to 0.05 MPa.
- If you need a pipe longer than specified in piping codes and standards, you must add refrigerant to the pipe. Otherwise, the indoor unit may freeze.
- While removing burrs, put the pipe face down to make sure that the burrs do not get in to the pipe.

The air in the indoor unit and in the pipe must be evacuated. If air remains in the refrigerant pipes, it will affect the compressor either reduce cooling/heating capacity or lead to a malfunction. Use Vacuum Pump as shown on the next page figure.

- 1 Connect each assembly pipe to the appropriate valve on the outdoor unit and tighten the flare nut.
- 2 Referring to the illustration below, tighten the flare nut on section D first manually and then with a torque wrench, applying the following torque.

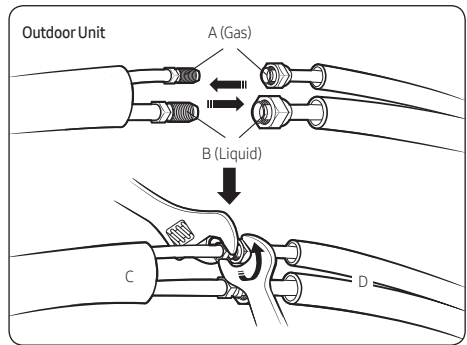

| Outer diameter (mm) | Torque (N • m) |
|---------------------|----------------|
| ø6.35 | 14 to 18 |
| ø9.52 | 34 to 42 |
| ø12.70 | 49 to 61 |
| ø15.88 | 68 to 82 |
| ø19.05 | 100 to 120 |

Step 7 Connecting up and removing air in the circuit


⚠ CAUTION

- When installing, make sure there is no leakage. When recovering the refrigerant, ground the compressor first before removing the connection pipe. If the refrigerant pipe is not properly connected and the compressor works with the service valve open, the pipe inhales the air and it makes the pressure inside of the refrigerant cycle abnormally high. It may cause explosion and injury.

- 1 N·m = 10 kgf·cm
- 3 Connect the charging hose of low pressure side of manifold gauge to the packed valve having a service port as shown at the figure.

⚠ CAUTION

- The designs and shape are subject to change according to the model.
- 4 Open the valve of the low pressure side (A) of manifold gauge anticlockwise.

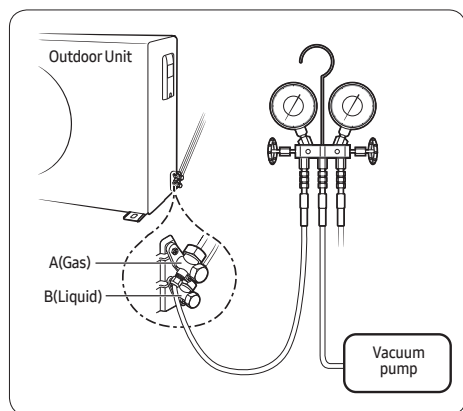

Step 8 Adding refrigerant (R-32)

Precautions on adding the R-32 refrigerant

In addition to the conventional charging procedure, the following requirements shall be kept.

- Make sure that contamination by other refrigerants does not occur for charging.
- To minimize the amount of refrigerant, keep the hoses and lines as short as possible.
- The cylinders shall be kept upright.
- Make sure that the refrigeration system is earthed before charging.
- Label the system after charging, if necessary.
- Extreme care is required not to overcharge the system.
- Before recharging, the pressure shall be checked with nitrogen blowing.
- After charging, check for leakage before commissioning.
- Be sure to check for leakage before leaving the work area.

The outdoor unit is loaded with sufficient refrigerant for the standard piping. Thus, refrigerant must be added if the piping is lengthened. This operation can only be performed by a qualified refrigeration specialist. To determine the quantity of refrigerant charge, see **Calculating the quantity of refrigerant to add** on page 25



- 1 Check if the stop valve is closed completely.
- 2 Charge the refrigerant through the service port of the liquid stop valve.
- 3 If you have any difficulty charging the refrigerant as described in the steps above, take the following steps:
 - a Open the liquid stop valve and gas stop valve.
 - b Operate the air conditioner by pressing the K2 key on the outdoor unit PCB.
 - c After about 30 minutes, charge the refrigerant through the service port of the gas stop valve.

- 5 Purge the air from the system using vacuum pump for about 10 minutes.
 - Close the valve of the low pressure side of manifold gauge clockwise.
 - Make sure that pressure gauge shows -0.1 MPa (-76 cmHg) after about 1 hour. This procedure is very important to avoid a gas leak.
 - Turn off the vacuum pump.
 - Remove the hose of the low pressure side of manifold gauge.
- 6 Open the stop valve of both liquid and gas sides.
- 7 Mount the valve stem nuts and the service port cap to the valve, and tighten them at the torque of $183 \text{ kgf}\cdot\text{cm}$ with a torque wrench.
- 8 Check for gas leakage.
 - At this time, especially check for gas leakage from the 3-way valve's stem nuts(A port), and from the service port cap.

CAUTION

- Connect the indoor and outdoor units using pipes with flared connections (not supplied). For the lines, use insulated, unwelded, degreased and deoxidized copper pipe, (Cu DHP type to ISO 1337 or UNI EN 12735-1), suitable for operating pressures of at least 4200 kPa and for a burst pressure of at least 20700 kPa. Copper pipe for hydro-sanitary applications is completely unsuitable.
- For sizing and limits (height difference, line length, max. bends, refrigerant charge, etc.) see "Connecting refrigerant pipe section".

Installation Procedure

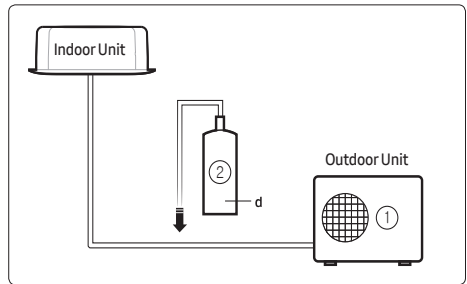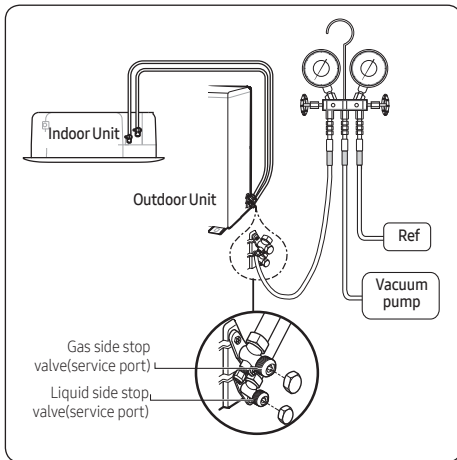

| Unit | kg | tCO ₂ e |
|----------|----|--------------------|
| ①, a | | |
| ②, b | | |
| ① + ②, c | | |

| Refrigerant type | GWP value |
|------------------|-----------|
| R-32 | 675 |

Important information: regulation regarding the refrigerant used

This product contains fluorinated greenhouse gases. Do not vent gases into the atmosphere.

⚠ CAUTION

- Inform user if the system contains 5 tCO₂e or more of fluorinated greenhouse gases. In this case, it must be checked for leakage at least once every 12 months, according to regulation No. 517/2014. This activity must be covered by qualified personnel only. In the case of the situation above, the installer (or authorized person with responsibility for final check) must provide a maintenance book, with all the information recorded, according to REGULATION (EU) No. 517/2014 OF THE EUROPEAN PARLIAMENT AND OF THE COUNCIL of 16 April 2014 on fluorinated greenhouse gases.

Please fill in the following with indelible ink on the refrigerant charge label supplied with this product and on this manual.

- ①: The factory refrigerant charge of the product.
- ②: The additional refrigerant amount charged in the field.
- ① + ②: The total refrigerant charge.

📄 NOTE

- Factory refrigerant charge of the product: see unit name plate
- Additional refrigerant amount charged in the field (Refer to the above information for the quantity of refrigerant replenishment.)
- Total refrigerant charge
- Refrigerant cylinder and manifold for charging

⚠ CAUTION

- The filled-out label must be adhered in the proximity of the product charging port (e.g. onto the inside of the stop valve cover).
- Make sure that the total refrigerant charge does not exceed (A), the maximum refrigerant charge, which is calculated in the following formula: Maximum refrigerant charge (A) = factory refrigerant charge (B) + maximum additional refrigerant charge due to piping extension (C).


(Unit: g)

| Model | A | B | C |
|-------------|------|------|-----|
| AC026RXADKG | 900 | 900 | 0 |
| AC035RXADKG | 900 | 900 | 0 |
| AC052RXADKG | 1500 | 1200 | 300 |
| AC071RXADKG | 2575 | 1700 | 875 |

Charging the refrigerant under conditions of liquid by using a liquid pipe

It is necessary for recharging under conditions of liquid. When recharging refrigerant from the refrigerant cylinder to the equipment, follow the instructions below.

- Before recharging, check whether the cylinder has a siphon or not. There are two ways to recharge the refrigerant.

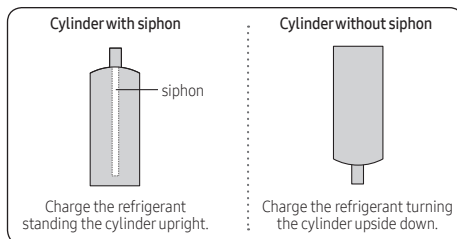

NOTE

- During the measuring operation of refrigerant quantity added use an electronic balance. If cylinder doesn't have siphon, upset it.

Calculating the quantity of refrigerant to add

The quantity of additional refrigerant is variable according to the installation situation. Thus, make sure the outdoor unit situation before adding refrigerant. This operation can only be performed by a qualified refrigeration specialist.

When installing the outdoor unit only

| Model | Interconnection pipe length (m) | | | | | |
|----------------------------|---------------------------------|-------------------|-------------------|----------|----------|----------|
| | 0 to 10 | 10 to 15 | 15 to 20 | 20 to 30 | 30 to 40 | 40 to 50 |
| AC026RXADKG AC035RXADKG | 0 | 0 | 0 | | | |
| AC052RXADKG | 0 | +15 g/m over 10 m | | | | |
| AC071RXADKG | 0 | 0 | +25 g/m over 15 m | | | |

DPM installation outdoor unit

| Model | Diameter of L ₁ , a & b pipe | Installation condition | Amount of additional refrigerant charging |
|-------------|---|--|---|
| AC071RXADKG | Φ 6.35 | L ₁ + L ₂ + L ₃ | (L ₁ -5) × 20[g] + (L ₂ +L ₃) × 20[g] |

Installation Procedure

Step 9 Optional: Installing DPM

DPM allowable Outdoor and indoor unit models

| DPM allowable Outdoor and indoor unit models | |
|--|---------------------------|
| Outdoor unit models | 2 indoor units connection |
| | Indoor unit |
| AC071RXADKG | AC035RN1DKG |
| | AC035RNNDKG |
| | AC035RNMDKG |
| | AC035RNLDKG |
| | AC035BNLDKG |
| | AC035RNADKG |
| AC035TNXDKG | |

* Installation of multiple indoor units should consist of units that have the same capacity.

e.g. When you install the AC071RXADKG outdoor unit as DPM combination such as 2 indoor units connection, only the combination on the table is available.

Space requirements for indoor and outdoor units and piping installation


(Refer to page 9-12 installation specification.)

- ▶ Two indoor units should be installed in one area which is not divided by a wall.
- ▶ The distance between two indoor units should be within a straight-line of 10m.
- ▶ After branching, the distance between the piping connected to the two indoor units should be within 5m.
- ▶ The height difference between two units should be within 0.5m.
- ▶ Use the joint KIT that is only for DPM. (Please refer to the table below)

| DPM KIT | 2-Indoor units connection | 3-Indoor units connection | 4-Indoor units connection |
|---------|---------------------------|---------------------------|---------------------------|
| | MXJ-2D2509K | MXJ-3D2509K | MXJ-4D2509K |

Connecting communication line and wired remote controller

In case of 2 indoor units connection



* The wired remote controller can be used with any of the DPM indoor units.

Operation and specification

- ▶ The two, the three, or the four sets of the indoor units with DPM installation which are controlled by wired and wireless remote controller work equally. (All controls such as ON/OFF, cooling/heating/dehumidification/ventilation, high/ medium/low wind.)
- ▶ Thermo OFF which stops when indoor temperature reaches set temperature works by the average sensor value of the indoor temperature of the all indoor units.
- ▶ When one of the several indoor units has a problem, they protect operation or stop working.

Instruction for installation and operation

- ▶ You should install the DPM according to the above installation specification and eliminate the factors that give electrical load to the both indoor units when installing and operating. (Heater / window / front door / ventilation / partition that divides space)
- ▶ You should provide sufficient instructions about the operation method and specification features to users and fill in caution phrases on wired remote controller when necessary.
 - <The air-conditioners in this area are special type to be controlled simultaneously.>

Set up indoor quantity by key switch(K1, K2)

- ▶ Press and hold K1 switch to enter the setting mode on the number of the installed indoor unit : Check "A0" sign on 7-segment
 - Press K2 switch to set the number of the installed indoor unit :
 - Ex) If there are two indoor units, press K2 switch twice, and check "A2" sign on 7-segment.
 - If there are three indoor units, press K2 switch three times, and check "A3" sign on 7-segment.
 - If there are four indoor units, press K2 switch four times, and check "A4" sign on 7-segment.
 - Unable to set more than the allowable indoor unit.
 - Ex) In case of the allowable indoor unit is two :
 - If you press K2 switch repeatedly, 7-segment is changed in order "A0"→"A1"→"A2"→"A0"→"A1".
 - Press K1 switch to complete setting the number of the installed indoor unit : Check "AA" sign on 7-segment.

Step 10 Performing the gas leak test


LEAK TEST WITH NITROGEN (before opening valves)

In order to detect basic refrigerant leaks, before recreating the vacuum and recirculating the R-32, it is the responsibility of the installer to pressurize the whole system with nitrogen (using a cylinder with pressure reducer) at a pressure above 0.2MPa, less than 4MPa (gauge).

LEAK TEST WITH R-32 (after opening valves)


Before opening valves, discharge all the nitrogen from the system and create vacuum. After opening valves check for leaks using a leak detector for refrigerant R-32.

Once you have completed all the connections, check for possible leaks using leak detector specifically designed for HFC refrigerants.

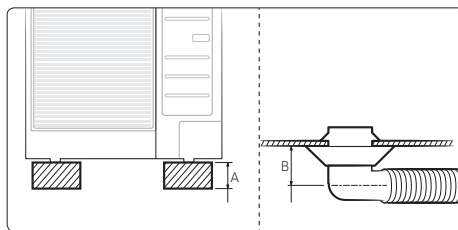

| Model | A | B |
|-------------|-------|-------|
| AC026RXADKG | 80 mm | 30 mm |
| AC035RXADKG | | |
| AC052RXADKG | | |
| AC071RXADKG | | |

5 Be sure to plug the rest of drain holes not connected with drain plugs using drain caps.


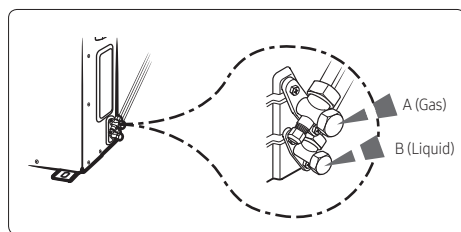


- The designs and shape are subject to change according to the model.

Step 11 Connecting the drain hose to the outdoor unit

When using the air conditioner in the heating mode, ice may accumulate. During de-icing (defrost operation), the defrosting water must be drained off safely. Consequently, you must install a drain hose on the outdoor unit, following the instructions below.

- Make space more than "A" mm between the bottom of the outdoor unit and the ground for installation of the drain hose, as shown in figure.
- Insert the drain plug into the hole on the underside of the outdoor unit.
- Connect the drain hose to the drain plug.
- Ensure that the drained water runs off correctly and safely. If needed apply a heating cable to prevent freezing of the drain hose/ pipe.

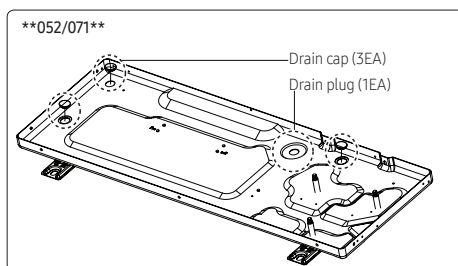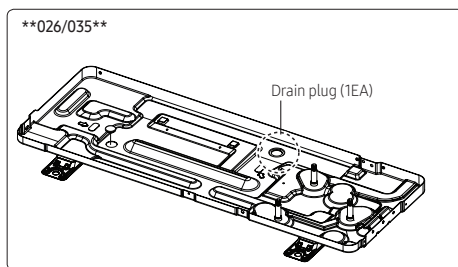


- When installing the product, make sure that the rack is not placed under the drain hole.
- If the product is installed in a region of heavy snow, allow enough separation distance between the product and the ground.

Installation Procedure

Step 12 Insulating the refrigerant pipes

Once you have checked that there are no leaks in the system, you can insulate the piping and hose.

- 1 To avoid condensation problems, place an insulator around each refrigerant pipe.

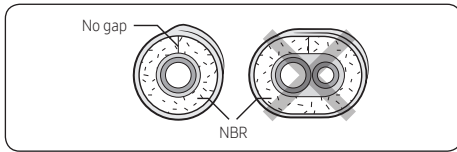

NOTE

- When insulate the pipe, be sure to overlap the insulation.
- The insulation has to be produced in full compliance of European regulation reg. EEC / EU 2037/ 2000 that requires the use of sheaths insulation form without using CFC and HCFC gases for health and the environment.

CAUTION

- 1 When insulating the pipe, use non-slit insulator.
- 2 Select the insulation of the refrigerant pipe.
 - Insulate the gas side and liquid side pipe referring to the thickness according to the pipe size.
 - Less than Indoor temperature of 30°C and humidity of 85% is the standard condition. If installing in a high humidity condition, use one grade thicker insulator by referring to the table below. If installing in an unfavourable conditions, use thicker one.
 - Insulator's heat-resistance temperature should be more than 120°C.

| Pipe | Pipe size | Insulation Type (Heating/Cooling) | | Remarks |
|-------------|--------------|-----------------------------------|--------------------------------|---|
| | | Standard [Less than 30°C, 85%] | High humidity [over 30°C, 85%] | |
| | | EPDM, NBR | | |
| Liquid pipe | Ø6.35-Ø9.52 | 9 t | 9 t | Internal temperature is higher than 120°C |
| | Ø12.7-Ø19.05 | 13 t | 13 t | |
| Gas pipe | Ø6.35 | 13 t | 19 t | |
| | Ø9.52-Ø19.05 | 19 t | 25 t | |

- When installing insulation in places and conditions below, use the same insulation that is used for high humidity conditions.

<Geological condition>

- High humidity places such as shoreline, hot spring, near lake or river, and ridge (when the part of the building is covered by earth and sand.)

<Operation purpose condition>

- Restaurant ceiling, sauna, swimming pool etc.
- <Building construction condition>
- The ceiling frequently exposed to moisture and cooling is not covered.
- e.g. The pipe installed at a corridor of a dormitory and studio or near an exit that opens and closes frequently.
- The place where the pipe is installed is highly humid due to the lack of ventilation system.


Step 13 Checking the earthing

If the power distribution circuit does not have a earthing or the earthing does not comply with specifications, an earthing electrode must be installed. The corresponding accessories are not supplied with the air conditioner.

- 1 Select an earthing electrode that complies with the specifications given in the illustration.
- 2 Connect the flexible hose to the flexible hose port.
 - In damp hard soil rather than loose sandy or gravel soil that has a higher earthing resistance.
 - Away from underground structures or facilities, such as gas pipes, water pipes, telephone lines and underground cables.
 - At least two metres away from a lightning conductor earthing electrode and its cable.

NOTE

- The earthing wire for the telephone line cannot be used to ground the air conditioner.

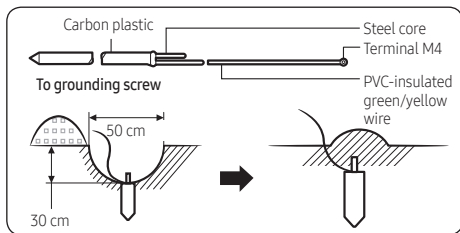

- 3 Finish wrapping insulating tape around the rest of the pipes leading to the outdoor unit.
- 4 Install a green/yellow coloured earthing wire:
 - If the earthing wire is too short, connect an extension lead in a mechanical way and wrap it with insulating tape (do not bury the connection).
 - Secure the earthing wire in position with staples.

NOTE

- If the earthing electrode is installed in an area with heavy traffic, its wire must be connected securely.
- 5 Carefully check the installation by measuring the earthing resistance with an earth resistance tester. If the resistance is above the required level, drive the electrode deeper into the ground or increase the number of earthing electrodes.
 - 6 Connect the earthing wire to the electrical component box inside of the outdoor unit.

Step 14 Performing final check and trial operation

<Main PCB>



- 1 Check the power supply between the outdoor unit and the auxiliary circuit breaker.
 - 1 phase power supply: L, N

- 2 Check the indoor unit.
 - a Check that you have connected the power and communication cables correctly. (If the power cable and communication cables are mixed up or connected incorrectly, the PCB will be damaged.)
 - b Check that the thermistor sensor, drain pump/hose, and display are connected correctly.
- 3 Press K1 or K2 on the outdoor unit PCB to run the test mode and stop.

| Key | Push type | Mode | Display | | | |
|-----|-----------|-----------------------------|---------|-------|-------|-------|
| | | | SEG 1 | SEG 2 | SEG 3 | SEG 4 |
| K1 | Short | 1st Heating test mode | F | 1 | 8 | 8 |
| | | 2nd Defrost test mode* | F | 3 | 8 | 8 |
| | | 3rd Stop | 8 | 8 | 8 | 8 |
| K2 | Short | 1st Cooling test | F | 2 | 8 | 8 |
| | | 2nd Inverter check | F | 4 | 8 | 8 |
| | | 3rd Pump down | F | b | 8 | 8 |
| | | 4th Stop | 8 | 8 | 8 | 8 |
| K3 | Short | 1st Reset Release Eco mode* | 8 | 8 | 8 | 8 |

* Defrost test mode

Condition 1: The outdoor temperature is under 10°C

Condition 2: All the temperature conditions should meet the defrost conditions

- 4 After 12 minutes of stationary condition check each indoor unit air treatment:
 - Cooling mode (indoor unit check) → Inlet air temp. - Outlet air temp.: From 10°C to 12°C
 - Heating mode (indoor unit check) → Outlet air temp. - Inlet air temp.: From 11°C to 14°C
 - In heating mode, the indoor fan motor can remain off to avoid cold air blown into air-conditioned space.
 - 5 How to reset the power supply of the outdoor unit and deactivate the eco mode (standby mode):
 - Press K3 button over 1 sec to reset the power supply of the outdoor unit and deactivate the eco mode (standby mode).
- * Eco mode : Standby for minimizing power onsumption
- 6 View mode: When the K4 switch is pressed, you can see information about our system state as below.

Installation Procedure

| K4 short push | Display contents | SEG1 | SEG2 | SEG3 | SEG4 | Unit |
|---------------|--------------------------------------|------|--------------------------|--|---|------|
| 1 | Order frequency | 1 | Hundreds digit | Tens digit | Units digit | Hz |
| 2 | Current frequency | 2 | Hundreds digit | Tens digit | Units digit | Hz |
| 3 | The number of preset indoor units | 3 | Hundreds digit | Tens digit | Units digit | EA |
| 4 | Ambient temperature sensor | 4 | + / - | Tens digit | Units digit | °C |
| 5 | Compressor discharge sensor | 5 | Hundreds digit | Tens digit | Units digit | °C |
| 6 | Eva sensor | 6 | + / - | Tens digit | Units digit | °C |
| 7 | Condensor sensor | 7 | + / - | Tens digit | Units digit | °C |
| 8 | Current | 8 | Tens digit | Units digit | The first place of decimals | A |
| 9 | Fan RPM | 9 | Thousands digit | Hundreds digit | Tens digit | rpm |
| 10 | Target discharge temperature | A | Hundreds digit | Tens digit | Units digit | °C |
| 11 | EEV | B | Hundreds digit | Tens digit | Units digit | step |
| 12 | The capacity sum of indoor units | C | Tens digit | Unit digit | The first place of decimals | kW |
| 13 | Protective control | D | 0: Cooling 1: Heating | Protective control 0: No Protective control 1: Freezing 2: Non-stop defrosting 3: Over-load 4: Discharge 5: Total electric current | Frequency status 0: Normal 1: Hold 2: Down 3: Up_limit 4: Down_limit | - |
| 14 | IPM temperature | E | Hundreds digit | Tens digit | Units digit | - |
| 15 | The number of connected indoor units | F | 0 | Tens digit | Units digit | EA |


| | | Display contents | SEG1 | SEG2 | SEG3 | SEG4 |
|--------------|--------------------|---|------------|-------------|-------------------|--------------------|
| K4 long push | - | Main micom version | Year (Dec) | Month (Hex) | Date (Tens digit) | Date (Units digit) |
| | After short push 1 | Inverter micom version | Year (Dec) | Month (Hex) | Date (Tens digit) | Date (Units digit) |
| | After short push 2 | E2P version | Year (Dec) | Month (Hex) | Date (Tens digit) | Date (Units digit) |
| | After short push 3 | Page1 -AUTO Page2 - (SEG1,2 - Indoor unit: "A","0")(SEG3,4 - Address: ex) 00 | | | | |
| | After short push 4 | Page1 -MANU Page2 - (SEG1,2 - Indoor unit: "A","0")(SEG3,4 - Address: ex) 00 | | | | |

- Long push K4 (Main micom ver.) → short push 1 more (Inv. micom ver.) → short push 1 more (E2P. ver.)

7 Setting outdoor unit option switch and address manually


a Setting the option

- Press and hold K2 to enter the option setting. (Only available when the operation is stopped)
 - If you enter the option setting, display will show the following.

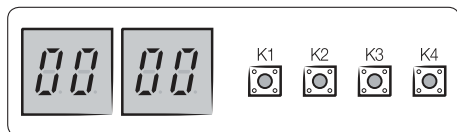


- Seg 1 and Seg 2 will display the number for selected option.
- Seg 3 and Seg 4 will display the number for set value of the selected option.
- If you have selected desired option, you can shortly press the K2 switch to adjust the value of the Seg 3, Seg 4 and change the function for the selected option.

Example)

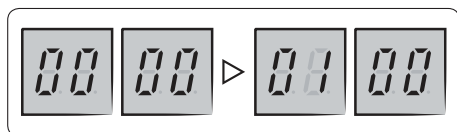

- If you have selected desired option, you can shortly press the K2 switch to adjust the value of the Seg 3, Seg 4 and change the function for the selected option.

Example)

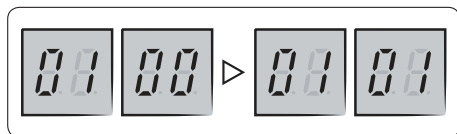

- After selecting the function for options, press and hold the K2 switch for 2 seconds. Edited value of the option will be saved when entire segments blinks and tracking mode begins.

| Option item | Input unit | SEG1 | SEG2 | SEG3 | SEG4 | Function |
|--------------------------------------|------------|------|------|-------|------|--|
| Channel address | Main | 0 | 0 | A | U | Automatic setting (Factory default) |
| | | | | 00~15 | | Manual setting |
| Snow accumulation prevention control | Main | 0 | 1 | 0 | 0 | Disabled (Factory default) |
| | | | | 0 | 1 | Enabled |
| Step for Silence mode | Main | 0 | 2 | 0 | 0 | Disabled (Factory default) |
| | | | | 0 | 1 | Step1 |
| | | | | 0 | 2 | Step2 |
| | | | | 0 | 3 | Step3 |
| Type of Silence mode | Main | 0 | 3 | 0 | 0 | Automatic Silence mode (Factory default) |
| | | | | 0 | 1 | Manual Silence mode |

⚠ CAUTION

- Edited option will not be saved if you do not end the option setting as explained in above instruction.
- ⚡ While you are setting the option, you may press and hold the K1 button to reset the value to previous setting.
- ⚡ If you want to restore the setting to factory default, press and hold the K4 button while you are in the option setting mode.
 - If you press and hold the K4 button, setting will be restored to factory default but it doesn't mean that restored setting is saved. Press and hold the K2 button. When the segments shows that tracking mode is in progress, setting will be saved.

Extra Procedures

Pumping down refrigerant


WARNING

- After installing the product, be sure to perform leak tests on the piping connections. After pumping down refrigerant to inspect or relocate the outdoor unit, be sure to stop the compressor and then remove the connected pipes.
 - Do not operate the compressor for pump down when the refrigerant circuit is open due to a refrigerant leakage or a disconnected (or incorrectly connected) pipe. Failure to do so may cause air to flow into the compressor and a too high pressure can develop inside the refrigerant circuit, leading to an explosion or product malfunction.

Pump-down is an operation intended to collect all the system refrigerant in the outdoor unit.

This operation must be carried out before disconnecting the refrigerant pipe in order to avoid refrigerant loss to the atmosphere.

- 1 Turn the system on in cooling with fan operating at high velocity and then let the compressor run for more than 5 minutes. (Compressor will immediately start, provided 3 minutes have elapsed since the last stop.)
- 2 Release the valve caps on High and Low pressure side.
- 3 Use L-wrench to close the valve on the high pressure side.
- 4 After approximately 2 minute, close the valve on the low pressure side.
- 5 Stop operation of the air conditioner by pressing the (Power) button on the indoor unit or remote control.
- 6 Disconnect the pipes.

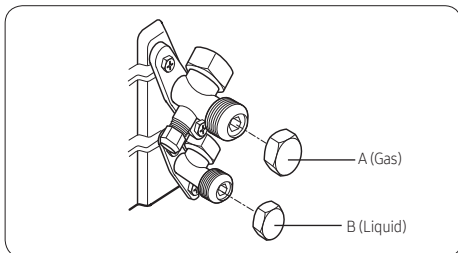

Relocating the indoor and outdoor units


- 1 Pump down refrigerant. See **Pumping down refrigerant** on page 32.
- 2 Disconnect the power supply only after rendering the system powerless from the mains power.
- 3 Disconnect the assembly cable from the indoor and outdoor units.
- 4 Remove the flare nuts connecting the indoor units and the pipes. At this time, cover the pipes of the indoor unit and the other pipes using a cap or vinyl plug to avoid foreign material entering.
- 5 Disconnect the pipes connected to the outdoor units. At this time, cover the valve of the outdoor units and the other pipes using a cap or vinyl plug to avoid foreign material entering.

Note: Make sure you do not bend the connection pipes in the middle and store together with the cables.
- 6 Move the indoor and outdoor units to a new location.
- 7 Remove the mounting plate for the indoor unit and move it to a new location.

Using the stop valve

Opening the stop valve

- 1 Open the cap and turn the stop valve anticlockwise by using a hexagonal wrench.
- 2 Turn it until the axis is stopped.

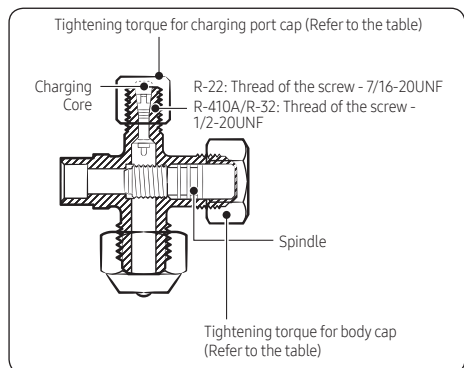

- 3 Tighten the cap securely.

| Outer Diameter (mm) | Tightening torque | |
|------------------------|-------------------|----------------------------|
| | Body cap (N•m) | Charging port cap (N•m) |
| Ø6.35 | 20 to 25 | 10 to 12 |
| Ø9.52 | 20 to 25 | |
| Ø12.70 | 25 to 30 | |
| Ø15.88 | 30 to 35 | |
| Over Ø19.05 | 35 to 40 | |

(1 N•m=10 kgf•cm)

NOTE

- Do not apply excessive force to the stop valve and always use special instruments. Otherwise, the stopping box can be damaged and the back sheet can leak.
- If the watertight sheet leaks, turn the axis back by half, tighten the stopping box, then check the leakage again. If there is no leakage any more, tighten the axis entirely.

Closing the stop valve

- 1 Remove the cap.
- 2 Turn the stop valve clockwise by using a hexagonal wrench.
- 3 Tighten the axis until the valve reached the sealing point.
- 4 Tighten the cap securely.

CAUTION

- When you use the service port, always use a charging hose, too.
- Check the leakage of refrigerant gas after tightening the cap.
- Must use a spanner and wrench when you open/tighten the stop valve.

Maintenance Procedures

Performing the gas leak tests for repair

In case of repair of the refrigerant circuit, the following procedure must be kept to consider flammability.

- 1 Remove the refrigerant.
- 2 Purge the refrigerant circuit with inert gas.
- 3 Perform evacuation.
- 4 Purge the circuit again with inert gas.
- 5 Open the circuit.
- 6 Perform repair work.
- 7 Charge the system with refrigerant.
- 8 Flush the system with nitrogen blowing for safety.
- 9 Repeat the previous steps several times until no refrigerant is within the system.

CAUTION

- Compressed air or oxygen shall not be used.
- Flush the system with nitrogen blowing, fill the refrigerant until the working pressure is reached, ventilate to atmosphere, and then pull down to a vacuum state.
- For the final nitrogen blowing charge, the system shall be ventilated down to atmospheric pressure.
- The procedure is absolutely vital in case of brazing on the pipings.
- Make sure that the outlet of the vacuum pump is not closed to any ignition sources and there is ventilation available.
- Do not apply any permanent inductive or capacitance loads to the circuit without ensuring that this will not exceed the permissible voltage and current permitted for the air conditioner.

Decommissioning

The following requirements must be fulfilled before and while taking the decommissioning procedure:

- Before decommissioning, the worker shall be familiar with the product details.
- The entire refrigerant shall be recovered safely.

- Before starting the process, oil and refrigerant samples shall be taken just in case analysis is required for reuse.
 - Before starting the process, power supply must be available.
- 1 Be familiar with the equipment details.
 - 2 Isolate the system electrically.
 - 3 Before starting the process, make sure that:
 - Any mechanical equipment is available for handling refrigerant cylinders.
 - All PPE (personal protective equipment) is available for servicing.
 - The recovery process shall be supervised by a competent person.
 - The recovery equipment and cylinders comply with the standards.
 - 4 Lower the refrigeration system, if possible.
 - 5 If vacuuming is not possible, make a manifold so that refrigerant can be easily removed from the parts of the system.
 - 6 Make sure that the cylinders are placed on the scales before recovery.
 - 7 Run the recovery system in accordance with the manufacturer's instructions.
 - 8 Do not overcharge the cylinders. (No more than 80 %)
 - 9 Be sure to keep the cylinder within the maximum working pressure, even temporarily.
 - 10 After charging, make sure that the cylinders and the equipment are promptly removed from the site and all isolation valves are closed.
 - 11 Recovered refrigerant shall not be charged into other refrigeration system unless it is cleaned and checked.

Appendix

COMMISSION DELEGATED REGULATION (EU) No 626/2011¹⁾

PRODUCT FICHE (ENERGY LABELLING OF AIR CONDITIONERS)¹⁾

| A | Supplier's name | - | Samsung | | | | |
|----|--|-----------------------|---------------------------|---------------------------|---------------------------|---------------------------|---------------------------|
| B | Model name (Indoor/Outdoor) | - | AC026RN1DKG / AC026RXADKG | AC035RN1DKG / AC035RXADKG | AC026RNNDKG / AC026RXADKG | AC035RNNDKG / AC035RXADKG | AC052RNNDKG / AC052RXADKG |
| C | Sound Power Level (Inside/Outside) | dB(A) | 52 / 59 | 55 / 61 | 48 / 59 | 50 / 61 | 56 / 62 |
| D | Refrigerant name ¹⁾ | - | R-32 | R-32 | R-32 | R-32 | R-32 |
| E | GWP | - | 675 | 675 | 675 | 675 | 675 |
| F | SEER | - | 6,4 | 6,2 | 7,1 | 7,0 | 6,7 |
| G | Energy efficiency class (SEER) | - | A++ | A++ | A++ | A++ | A++ |
| H | Q _{ce} ²⁾ (cooling season) | kWh/a ⁱⁱⁱ⁾ | 142 | 198 | 128 | 175 | 261 |
| I | P _{designc} | kW | 2,6 | 3,5 | 2,6 | 3,5 | 5,0 |
| J | SCOP (Average) | - | 4,0 | 4,0 | 4,3 | 4,3 | 4,2 |
| K | Energy efficiency class SCOP (Average) | - | A+ | A+ | A+ | A+ | A+ |
| L | Q _{he} ³⁾ heating season (Average) | kWh/a ⁱⁱⁱ⁾ | 700 | 700 | 684 | 684 | 800 |
| M | P _{designh} (Average) | kW | 2,0 | 2,0 | 2,1 | 2,1 | 2,4 |
| N | Back up heating capacity (Average) | kW | 0 | 0 | 0 | 0 | 0 |
| O | Declared capacity (Average) | kW | 2,0 | 2,0 | 2,1 | 2,1 | 2,4 |
| P | Other heating seasons suitable for use | - | .iv) | | | | |
| Q | SCOP (Warmer) | - | - | - | - | - | - |
| R | Energy efficiency class SCOP (Warmer) | - | - | - | - | - | - |
| S | Q _{he} ³⁾ heating season (Warmer) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - | - |
| T | P _{designh} (Warmer) | kW | - | - | - | - | - |
| U | Back up heating capacity (Warmer) | kW | - | - | - | - | - |
| V | Declared capacity (Warmer) | kW | - | - | - | - | - |
| W | SCOP (Colder) | - | - | - | - | - | - |
| X | Energy efficiency class SCOP (Colder) | - | - | - | - | - | - |
| Y | Q _{he} ³⁾ heating season (Colder) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - | - |
| Z | P _{designh} (Colder) | kW | - | - | - | - | - |
| AA | Back up heating capacity (Colder) | kW | - | - | - | - | - |
| AB | Declared capacity (Colder) | kW | - | - | - | - | - |

- 1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to [675].

This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be [675] times higher than 1 kg of CO₂, over a period of 100 years.

Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

- 2 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- 3 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

Appendix

COMMISSION DELEGATED REGULATION (EU) No 626/2011¹⁾

PRODUCT FICHE (ENERGY LABELLING OF AIR CONDITIONERS)²⁾

| A | Supplier's name | - | Samsung | | | | |
|----|--|-----------------------|---------------------------|---------------------------|---------------------------|---------------------------|---------------------------|
| B | Model name (Indoor/Outdoor) | - | AC071RNNDKG / AC071RXADKG | AC052RN4DKG / AC052RXADKG | AC071RN4DKG / AC071RXADKG | AC071RN4PKG / AC071RXADKG | AC026RNLDKG / AC026RXADKG |
| C | Sound Power Level (Inside/Outside) | dB(A) | 58 / 65 | 49 / 62 | 53 / 65 | 53 / 65 | 53 / 59 |
| D | Refrigerant name ³⁾ | - | R-32 | R-32 | R-32 | R-32 | R-32 |
| E | GWP | - | 675 | 675 | 675 | 675 | 675 |
| F | SEER | - | 6,1 | 7,6 | 6,7 | 6,7 | 6,2 |
| G | Energy efficiency class (SEER) | - | A++ | A++ | A++ | A++ | A++ |
| H | Q _{ce} ²⁾ (cooling season) | kWh/a ⁱⁱⁱ⁾ | 390 | 230 | 371 | 371 | 147 |
| I | P _{designc} | kW | 6,8 | 5,0 | 7,1 | 7,1 | 2,6 |
| J | SCOP (Average) | - | 3,8 | 4,3 | 4,2 | 4,2 | 4,0 |
| K | Energy efficiency class SCOP (Average) | - | A | A+ | A+ | A+ | A+ |
| L | Q _{he} ³⁾ heating season (Average) | kWh/a ⁱⁱⁱ⁾ | 1474 | 847 | 1500 | 1500 | 700 |
| M | P _{designh} (Average) | kW | 4,0 | 2,6 | 4,5 | 4,5 | 2,0 |
| N | Back up heating capacity (Average) | kW | 0 | 0 | 0 | 0 | 0 |
| O | Declared capacity(Average) | kW | 4,0 | 2,6 | 4,5 | 4,5 | 2,0 |
| P | Other heating seasons suitable for use | - | iv) | | | | |
| Q | SCOP (Warmer) | - | - | - | - | - | - |
| R | Energy efficiency class SCOP (Warmer) | - | - | - | - | - | - |
| S | Q _{he} ³⁾ heating season (Warmer) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - | - |
| T | P _{designh} (Warmer) | kW | - | - | - | - | - |
| U | Back up heating capacity (Warmer) | kW | - | - | - | - | - |
| V | Declared capacity (Warmer) | kW | - | - | - | - | - |
| W | SCOP (Colder) | - | - | - | - | - | - |
| X | Energy efficiency class SCOP (Colder) | - | - | - | - | - | - |
| Y | Q _{he} ³⁾ heating season (Colder) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - | - |
| Z | P _{designh} (Colder) | kW | - | - | - | - | - |
| AA | Back up heating capacity (Colder) | kW | - | - | - | - | - |
| AB | Declared capacity (Colder) | kW | - | - | - | - | - |

1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to [675].

This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be [675] times higher than 1 kg of CO₂, over a period of 100 years.

Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

- 2 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- 3 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

COMMISSION DELEGATED REGULATION (EU) No 626/2011¹⁾

PRODUCT FICHE (ENERGY LABELLING OF AIR CONDITIONERS)¹⁾

| A | Supplier's name | - | Samsung | | | | |
|----|--|-----------------------|---------------------------|---------------------------|---------------------------|---------------------------|---------------------------|
| B | Model name (Indoor/Outdoor) | - | AC035RNLDKG / AC035RXADKG | AC052RNLDKG / AC052RXADKG | AC071RNLDKG / AC071RXADKG | AC026BNLDKG / AC026RXADKG | AC035BNLDKG / AC035RXADKG |
| C | Sound Power Level (Inside/Outside) | dB(A) | 53 / 61 | 55 / 62 | 59 / 65 | 53 / 59 | 53 / 61 |
| D | Refrigerant name ¹⁾ | - | R-32 | R-32 | R-32 | R-32 | R-32 |
| E | GWP | - | 675 | 675 | 675 | 675 | 675 |
| F | SEER | - | 6,1 | 6,1 | 6,0 | 6,2 | 6,1 |
| G | Energy efficiency class (SEER) | - | A++ | A++ | A+ | A++ | A++ |
| H | Q _{EE} ²⁾ (cooling season) | kWh/a ⁱⁱⁱ⁾ | 201 | 287 | 414 | 147 | 201 |
| I | P _{designc} | kW | 3,5 | 5,0 | 7,1 | 2,6 | 3,5 |
| J | SCOP (Average) | - | 4,0 | 3,9 | 3,9 | 4,0 | 4,0 |
| K | Energy efficiency class SCOP (Average) | - | A+ | A | A | A+ | A+ |
| L | Q _{HE} ³⁾ heating season (Average) | kWh/a ⁱⁱⁱ⁾ | 700 | 862 | 1328 | 700 | 700 |
| M | P _{designh} (Average) | kW | 2,0 | 2,4 | 3,7 | 2,0 | 2,0 |
| N | Back up heating capacity (Average) | kW | 0 | 0 | 0 | 0 | 0 |
| O | Declared capacity (Average) | kW | 2,0 | 2,4 | 3,7 | 2,0 | 2,0 |
| P | Other heating seasons suitable for use | - | .iv) | | | | |
| Q | SCOP (Warmer) | - | - | - | - | - | - |
| R | Energy efficiency class SCOP (Warmer) | - | - | - | - | - | - |
| S | Q _{HE} ³⁾ heating season (Warmer) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - | - |
| T | P _{designh} (Warmer) | kW | - | - | - | - | - |
| U | Back up heating capacity (Warmer) | kW | - | - | - | - | - |
| V | Declared capacity (Warmer) | kW | - | - | - | - | - |
| W | SCOP (Colder) | - | - | - | - | - | - |
| X | Energy efficiency class SCOP (Colder) | - | - | - | - | - | - |
| Y | Q _{HE} ³⁾ heating season (Colder) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - | - |
| Z | P _{designh} (Colder) | kW | - | - | - | - | - |
| AA | Back up heating capacity (Colder) | kW | - | - | - | - | - |
| AB | Declared capacity (Colder) | kW | - | - | - | - | - |

- 1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to [675].

This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be [675] times higher than 1 kg of CO₂, over a period of 100 years.

Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

- 2 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- 3 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

Appendix

COMMISSION DELEGATED REGULATION (EU) No 626/2011¹⁾

PRODUCT FICHE (ENERGY LABELLING OF AIR CONDITIONERS)²⁾

| A | Supplier's name | - | Samsung | | | | |
|----|--|-----------------------|---------------------------|---------------------------|---------------------------|---------------------------|---------------------------|
| B | Model name (Indoor/Outdoor) | - | AC052BNLDKG / AC052RXADKG | AC071BNLDKG / AC071RXADKG | AC035RNMDKG / AC035RXADKG | AC052RNMDKG / AC052RXADKG | AC071RNMDKG / AC071RXADKG |
| C | Sound Power Level (Inside/Outside) | dB(A) | 55 / 62 | 59 / 65 | 52 / 61 | 55 / 62 | 56 / 65 |
| D | Refrigerant name ³⁾ | - | R-32 | R-32 | R-32 | R-32 | R-32 |
| E | GWP | - | 675 | 675 | 675 | 675 | 675 |
| F | SEER | - | 6,1 | 6,0 | 6,4 | 6,3 | 6,1 |
| G | Energy efficiency class (SEER) | - | A++ | A+ | A++ | A++ | A++ |
| H | Q _{ce} ²⁾ (cooling season) | kWh/a ⁱⁱⁱ⁾ | 287 | 414 | 191 | 278 | 390 |
| I | Pdesignc | kW | 5,2 | 7,1 | 3,5 | 5,0 | 6,8 |
| J | SCOP (Average) | - | 4,0 | 3,9 | 4,1 | 4,1 | 4,0 |
| K | Energy efficiency class SCOP (Average) | - | A+ | A | A+ | A+ | A+ |
| L | Q _{he} ³⁾ heating season (Average) | kWh/a ⁱⁱⁱ⁾ | 840 | 1328 | 683 | 820 | 1295 |
| M | Pdesignh (Average) | kW | 2,4 | 3,7 | 2,0 | 2,4 | 3,7 |
| N | Back up heating capacity (Average) | kW | 0 | 0 | 0 | 0 | 0 |
| O | Declared capacity (Average) | kW | 2,4 | 3,7 | 2,0 | 2,4 | 3,7 |
| P | Other heating seasons suitable for use | - | .iv) | | | | |
| Q | SCOP (Warmer) | - | - | - | - | - | - |
| R | Energy efficiency class SCOP (Warmer) | - | - | - | - | - | - |
| S | Q _{he} ³⁾ heating season (Warmer) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - | - |
| T | Pdesignh (Warmer) | kW | - | - | - | - | - |
| U | Back up heating capacity (Warmer) | kW | - | - | - | - | - |
| V | Declared capacity (Warmer) | kW | - | - | - | - | - |
| W | SCOP (Colder) | - | - | - | - | - | - |
| X | Energy efficiency class SCOP (Colder) | - | - | - | - | - | - |
| Y | Q _{he} ³⁾ heating season (Colder) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - | - |
| Z | Pdesignh (Colder) | kW | - | - | - | - | - |
| AA | Back up heating capacity (Colder) | kW | - | - | - | - | - |
| AB | Declared capacity (Colder) | kW | - | - | - | - | - |

1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to [675].

This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be [675] times higher than 1 kg of CO₂, over a period of 100 years.

Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

- 2 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- 3 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

COMMISSION DELEGATED REGULATION (EU) No 626/2011¹⁾

PRODUCT FICHE (ENERGY LABELLING OF AIR CONDITIONERS)¹⁾

| A | Supplier's name | - | Samsung | | |
|----|--|-----------------------|---------------------------|---------------------------|---------------------------|
| B | Model name (Indoor/Outdoor) | - | AC026RNADKG / AC026RXADKG | AC035RNADKG / AC035RXADKG | AC052RNADKG / AC052RXADKG |
| C | Sound Power Level (Inside/Outside) | dB(A) | 56 / 59 | 59 / 61 | 60 / 62 |
| D | Refrigerant name ¹⁾ | - | R-32 | R-32 | R-32 |
| E | GWP | - | 675 | 675 | 675 |
| F | SEER | - | 6,6 | 6,5 | 6,2 |
| G | Energy efficiency class (SEER) | - | A++ | A++ | A++ |
| H | Q _€ ²⁾ (cooling season) | kWh/a ⁱⁱⁱ⁾ | 138 | 188 | 282 |
| I | P _{designc} | kW | 2,6 | 3,5 | 5,0 |
| J | SCOP (Average) | - | 4,0 | 4,0 | 3,9 |
| K | Energy efficiency class SCOP (Average) | - | A+ | A+ | A |
| L | Q _{he} ³⁾ heating season (Average) | kWh/a ⁱⁱⁱ⁾ | 700 | 700 | 862 |
| M | P _{designh} (Average) | kW | 2,0 | 2,0 | 2,4 |
| N | Back up heating capacity (Average) | kW | 0 | 0 | 0 |
| O | Declared capacity (Average) | kW | 2,0 | 2,0 | 2,4 |
| P | Other heating seasons suitable for use | - | .iv) | | |
| Q | SCOP (Warmer) | - | - | - | - |
| R | Energy efficiency class SCOP (Warmer) | - | - | - | - |
| S | Q _{he} ³⁾ heating season (Warmer) | kWh/a ⁱⁱⁱ⁾ | - | - | - |
| T | P _{designh} (Warmer) | kW | - | - | - |
| U | Back up heating capacity (Warmer) | kW | - | - | - |
| V | Declared capacity (Warmer) | kW | - | - | - |
| W | SCOP (Colder) | - | - | - | - |
| X | Energy efficiency class SCOP (Colder) | - | - | - | - |
| Y | Q _{he} ³⁾ heating season (Colder) | kWh/a ⁱⁱⁱ⁾ | - | - | - |
| Z | P _{designh} (Colder) | kW | - | - | - |
| AA | Back up heating capacity (Colder) | kW | - | - | - |
| AB | Declared capacity (Colder) | kW | - | - | - |

- 1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to [675].

This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be [675] times higher than 1 kg of CO₂, over a period of 100 years.

Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

- 2 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- 3 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

Appendix

COMMISSION DELEGATED REGULATION (EU) No 626/2011¹⁾

PRODUCT FICHE (ENERGY LABELLING OF AIR CONDITIONERS)¹⁾

| A | Supplier's name | - | Samsung | | |
|----|--|-----------------------|---------------------------|---------------------------|---------------------------|
| B | Model name (Indoor/Outdoor) | - | AC071RNADKG / AC071RXADKG | AC052RNCCKG / AC052RXADKG | AC071RNCCKG / AC071RXADKG |
| C | Sound Power Level (Inside/Outside) | dB(A) | 61 / 65 | 60 / 62 | 64 / 65 |
| D | Refrigerant name ³⁾ | - | R-32 | R-32 | R-32 |
| E | GWP | - | 675 | 675 | 675 |
| F | SEER | - | 6,4 | 6,4 | 5,6 |
| G | Energy efficiency class (SEER) | - | A++ | A++ | A+ |
| H | Q _{ce} ²⁾ (cooling season) | kWh/a ⁱⁱⁱ⁾ | 388 | 273 | 444 |
| I | P _{designc} | kW | 7,1 | 5,0 | 7,1 |
| J | SCOP (Average) | - | 4,0 | 3,9 | 3,9 |
| K | Energy efficiency class SCOP (Average) | - | A+ | A | A |
| L | Q _{he} ³⁾ heating season (Average) | kWh/a ⁱⁱⁱ⁾ | 1260 | 862 | 1256 |
| M | P _{designh} (Average) | kW | 3,6 | 2,4 | 3,5 |
| N | Back up heating capacity (Average) | kW | 0 | 0 | 0 |
| O | Declared capacity(Average) | kW | 3,6 | 2,4 | 3,5 |
| P | Other heating seasons suitable for use | - | - | .iv) | - |
| Q | SCOP (Warmer) | - | - | - | - |
| R | Energy efficiency class SCOP (Warmer) | - | - | - | - |
| S | Q _{he} ³⁾ heating season (Warmer) | kWh/a ⁱⁱⁱ⁾ | - | - | - |
| T | P _{designh} (Warmer) | kW | - | - | - |
| U | Back up heating capacity (Warmer) | kW | - | - | - |
| V | Declared capacity (Warmer) | kW | - | - | - |
| W | SCOP (Colder) | - | - | - | - |
| X | Energy efficiency class SCOP (Colder) | - | - | - | - |
| Y | Q _{he} ³⁾ heating season (Colder) | kWh/a ⁱⁱⁱ⁾ | - | - | - |
| Z | P _{designh} (Colder) | kW | - | - | - |
| AA | Back up heating capacity (Colder) | kW | - | - | - |
| AB | Declared capacity (Colder) | kW | - | - | - |

1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to [675].

This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be [675] times higher than 1 kg of CO₂, over a period of 100 years.

Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

- 2 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- 3 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

COMMISSION DELEGATED REGULATION (EU) No 626/2011¹⁾

PRODUCT FICHE (ENERGY LABELLING OF AIR CONDITIONERS)¹⁾

| A | Supplier's name | - | Samsung | | |
|----|--|-----------------------|---------------------------|---------------------------|---------------------------|
| B | Model name (Indoor/Outdoor) | - | AC026RNJDKG / AC026RXADKG | AC035RNJDKG / AC035RXADKG | AC052RNJDKG / AC052RXADKG |
| C | Sound Power Level (Inside/Outside) | dB(A) | 53 / 59 | 55 / 61 | 60 / 62 |
| D | Refrigerant name ¹⁾ | - | R-32 | R-32 | R-32 |
| E | GWP | - | 675 | 675 | 675 |
| F | SEER | - | 6,4 | 6,1 | 5,9 |
| G | Energy efficiency class (SEER) | - | A++ | A++ | A+ |
| H | Q _{ce} ²⁾ (cooling season) | kWh/a ⁱⁱⁱ⁾ | 142 | 201 | 297 |
| I | P _{designc} | kW | 2,6 | 3,5 | 5,0 |
| J | SCOP (Average) | - | 4,2 | 4,1 | 4,0 |
| K | Energy efficiency class SCOP (Average) | - | A+ | A+ | A+ |
| L | Q _{he} ³⁾ heating season (Average) | kWh/a ⁱⁱⁱ⁾ | 667 | 683 | 840 |
| M | P _{designh} (Average) | kW | 2,0 | 2,0 | 2,4 |
| N | Back up heating capacity (Average) | kW | 0 | 0 | 0 |
| O | Declared capacity (Average) | kW | 2,0 | 2,0 | 2,4 |
| P | Other heating seasons suitable for use | - | - | .iv) | - |
| Q | SCOP (Warmer) | - | - | - | - |
| R | Energy efficiency class SCOP (Warmer) | - | - | - | - |
| S | Q _{he} ³⁾ heating season (Warmer) | kWh/a ⁱⁱⁱ⁾ | - | - | - |
| T | P _{designh} (Warmer) | kW | - | - | - |
| U | Back up heating capacity (Warmer) | kW | - | - | - |
| V | Declared capacity (Warmer) | kW | - | - | - |
| W | SCOP (Colder) | - | - | - | - |
| X | Energy efficiency class SCOP (Colder) | - | - | - | - |
| Y | Q _{he} ³⁾ heating season (Colder) | kWh/a ⁱⁱⁱ⁾ | - | - | - |
| Z | P _{designh} (Colder) | kW | - | - | - |
| AA | Back up heating capacity (Colder) | kW | - | - | - |
| AB | Declared capacity (Colder) | kW | - | - | - |

- 1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to [675].

This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be [675] times higher than 1 kg of CO₂, over a period of 100 years.

Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

- 2 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- 3 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

Appendix

COMMISSION DELEGATED REGULATION (EU) No 626/2011¹⁾

PRODUCT FICHE (ENERGY LABELLING OF AIR CONDITIONERS)²⁾

| A | Supplier's name | - | Samsung | | | |
|----|--|-----------------------|---------------------------|---------------------------|---------------------------|---------------------------|
| B | Model name (Indoor/Outdoor) | - | AC026TNXDKG / AC026RXADKG | AC035TNXDKG / AC035RXADKG | AC052TNXDKG / AC052RXADKG | AC071TNXDKG / AC071RXADKG |
| C | Sound Power Level (Inside/Outside) | dB(A) | 56 / 59 | 59 / 61 | 60 / 62 | 61 / 65 |
| D | Refrigerant name ³⁾ | - | R-32 | R-32 | R-32 | R-32 |
| E | GWP | - | 675 | 675 | 675 | 675 |
| F | SEER | - | 7,0 | 6,9 | 6,9 | 6,8 |
| G | Energy efficiency class (SEER) | - | A++ | A++ | A++ | A++ |
| H | Q _{ce} ²⁾ (cooling season) | kWh/a ⁱⁱⁱ⁾ | 130 | 178 | 254 | 365 |
| I | P _{designc} | kW | 2,6 | 3,5 | 5,0 | 7,1 |
| J | SCOP (Average) | - | 4,1 | 4,1 | 3,9 | 4,0 |
| K | Energy efficiency class SCOP (Average) | - | A+ | A+ | A | A+ |
| L | Q _{he} ³⁾ heating season (Average) | kWh/a ⁱⁱⁱ⁾ | 717 | 717 | 862 | 1260 |
| M | P _{designh} (Average) | kW | 2,1 | 2,1 | 2,4 | 3,6 |
| N | Back up heating capacity (Average) | kW | 0 | 0 | 0 | 0 |
| O | Declared capacity(Average) | kW | 2,1 | 2,1 | 2,4 | 3,6 |
| P | Other heating seasons suitable for use | - | .iv) | | | |
| Q | SCOP (Warmer) | - | - | - | - | - |
| R | Energy efficiency class SCOP (Warmer) | - | - | - | - | - |
| S | Q _{he} ³⁾ heating season (Warmer) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - |
| T | P _{designh} (Warmer) | kW | - | - | - | - |
| U | Back up heating capacity (Warmer) | kW | - | - | - | - |
| V | Declared capacity (Warmer) | kW | - | - | - | - |
| W | SCOP (Colder) | - | - | - | - | - |
| X | Energy efficiency class SCOP (Colder) | - | - | - | - | - |
| Y | Q _{he} ³⁾ heating season (Colder) | kWh/a ⁱⁱⁱ⁾ | - | - | - | - |
| Z | P _{designh} (Colder) | kW | - | - | - | - |
| AA | Back up heating capacity (Colder) | kW | - | - | - | - |
| AB | Declared capacity (Colder) | kW | - | - | - | - |

1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to [675].

This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be [675] times higher than 1 kg of CO₂, over a period of 100 years.

Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

- 2 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- 3 Energy consumption "XYZ" kWh per year, based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

| | [Spanish-ES] | [French-FR] | [Italian-IT] |
|-----|--|--|--|
| i | REGLAMENTO DELEGADO (UE) No 626/2011 DE LA COMISIÓN | RÈGLEMENT DÉLÉGUÉ (UE) No 626/2011 DE LA COMMISSION | REGOLAMENTO DELEGATO (UE) N. 626/2011 DELLA COMMISSIONE |
| ii | Ficha del producto (etiquetado energético de los acondicionadores de aire) | Fiche produit (l'indication, par voie d'étiquetage, de la consommation d'énergie des climatiseurs) | Scheda prodotto (l'etichettatura indicante il consumo d'energia dei condizionatori d'aria) |
| iii | kWh/a | kWh/a | kWh/a |
| iv | - | - | - |
| A | Nombre del proveedor | Nom du fournisseur | Nome del Fornitore |
| B | Nombre del modelo/unidad interior/ exterior) | Nom du modèle(intérieur/extérieur) | Nome del Modello (Unità Interna/Unità Esterna) |
| C | Nivel de potencia acústica (interior/ exterior) | Niveau de puissance acoustique (intérieur/extérieur) | Livello della potenza sonora (interno/ esterno) |
| D | Nombre del refrigerante ¹⁾ | Nom du fluide frigorigène ¹⁾ | Tipo di refrigerante ¹⁾ |
| E | GWP | GWP | GWP |
| F | SEER | SEER | SEER |
| G | Clase de eficiencia energética (SEER) | Classe d'efficacité énergétique (SEER) | Classe di Efficienza Energetica (SEER) |
| H | Q _{CE} ²⁾ (temporada refrigeración) | Q _{CE} ²⁾ (saison froide) | Q _{CE} ²⁾ (stagione di raffreddamento) |
| I | Pdesignc | Pdesignc | Pdesignc |
| J | SCOP (Media) | SCOP (moyenne) | SCOP (Átlagos) |
| K | Clase de eficiencia energética SCOP (Media) | Classe d'efficacité énergétique SCOP (moyenne) | Energy efficiency class SCOP (Átlagos) |
| L | Q _{HE} ³⁾ temporada calefacción (Media) | Q _{HE} ³⁾ saison chaude (moyenne) | Q _{HE} ³⁾ altre stagioni d'uso (Átlagos) |
| M | Pdesignh (Media) | Pdesignh (moyenne) | Pdesignh (Átlagos) |
| N | Copia de seguridad de capacidad de calefacción (Media) | Sauvegarder la capacité de chauffage (moyenne) | Eseguire il backup di potenza termica (Átlagos) |
| O | Potencia declarada (Media) | Puissance frigorifique déclarée (moyenne) | Névleges hűtőteljesítmény (Átlagos) |
| P | Otras temporadas de calefacción declaradas aptas para funcionar | Adapté à d'autres saisons chaudes | Altre stagioni di utilizzo |
| Q | SCOP (Más cálida) | SCOP (plus chaude) | SCOP (Melegebb) |
| R | Clase de eficiencia energética SCOP (Más cálida) | Classe d'efficacité énergétique SCOP (plus chaude) | Energy efficiency class SCOP (Melegebb) |
| S | Q _{HE} ³⁾ temporada calefacción (Más cálida) | Q _{HE} ³⁾ saison chaude (plus chaude) | Q _{HE} ³⁾ altre stagioni d'uso (Melegebb) |
| T | Pdesignh (Más cálida) | Pdesignh (plus chaude) | Pdesignh (Melegebb) |
| U | Copia de seguridad de capacidad de calefacción (Más cálida) | Sauvegarder la capacité de chauffage (plus chaude) | Eseguire il backup di potenza termica (Melegebb) |
| V | Potencia declarada (Más cálida) | Puissance frigorifique déclarée (plus chaude) | Névleges hűtőteljesítmény (Melegebb) |
| W | SCOP (Más fría) | SCOP (plus froide) | SCOP (Hidegebb) |
| X | Clase de eficiencia energética SCOP (Más fría) | Classe d'efficacité énergétique SCOP (plus froide) | Energy efficiency class SCOP (Hidegebb) |
| Y | Q _{HE} ³⁾ temporada calefacción (Más fría) | Q _{HE} ³⁾ saison chaude (plus froide) | Q _{HE} ³⁾ altre stagioni d'uso (Hidegebb) |
| Z | Pdesignh (Más fría) | Pdesignh (plus froide) | Pdesignh (Hidegebb) |
| AA | Copia de seguridad de capacidad de calefacción (Más fría) | Sauvegarder la capacité de chauffage (plus froide) | Eseguire il backup di potenza termica (Hidegebb) |
| AB | Potencia declarada (Más fría) | Puissance frigorifique déclarée (plus froide) | Névleges hűtőteljesítmény (Hidegebb) |

Appendix

| | [Portuguese-PT] | [German-DE] | [Greek-EL] |
|-----|--|---|---|
| i | REGULAMENTO DELEGADO (UE) N.º 626/2011 DA COMISSÃO | DELEGIERTE VERORDNUNG (EU) Nr. 626/2011 DER KOMMISSION | ΚΑΤ' ΕΞΟΥΣΙΟΔΟΤΗΣΗ ΚΑΝΟΝΙΣΜΟΣ (ΕΕ) αριθ. 626/2011 ΤΗΣ ΕΠΙΤΡΟΠΗΣ |
| ii | Ficha de produto (rotulagem energética dos aparelhos de ar condicionado) | Produktdatenblatt (die Kennzeichnung von Luftkonditionierern in Bezug auf den Energieverbrauch) | Δελτίο προϊόντος (επίσημανση της κατανάλωσης ενέργειας των κλιματιστικών) |
| iii | kWh/a | kWh/a | kWh/έτος |
| iv | - | - | - |
| A | Nome do fornecedor | Name des Lieferanten | Όνομα προμηθευτή |
| B | Nome do modelo (interior/exterior) | Modellbezeichnung (Innen-/Außengerät) | Όνομασία μοντέλου (εσωτερικού χώρου/ εξωτερικού χώρου) |
| C | Nível de potência sonora (interior/ exterior) | Schalleistungspegel (innen/außen) | Στάθμη ηχητικής ισχύος (εσωτερικού/ εξωτερικού χώρου) |
| D | Nome do fluido refrigerante ¹⁾ | Name des Kältemittels ¹⁾ | Όνομα ψυκτικού μέσου ¹⁾ |
| E | GWP | GWP | GWP |
| F | SEER | SEER | SEER |
| G | Classe de eficiência energética (SEER) | Energieeffizienzklasse (SEER) | Τάξη ενεργειακής απόδοσης (SEER) |
| H | Q _{CE} ²⁾ (estação de arrefecimento) | Q _{CE} ²⁾ (Kühlperiode) | Q _{CE} ²⁾ (εποχή ψύξης) |
| I | Pdesignc | Pdesignc | Pdesignc |
| J | SCOP (Μέδια) | SCOP (mittel) | SCOP (μέση εποχή) |
| K | Classe de eficiência energética SCOP (Μέδια) | Energieeffizienzklasse SCOP (mittel) | Τάξη ενεργειακής απόδοσης SCOP (μέση εποχή) |
| L | Q _{HE} ³⁾ estação de aquecimento (Μέδια) | Q _{HE} ³⁾ Heizperiode (mittel) | Q _{HE} ³⁾ εποχή θέρμανσης (μέση εποχή) |
| M | Pdesignh (Μέδια) | Pdesignh (mittel) | Pdesignh (μέση εποχή) |
| N | Fazer backup de capacidade de aquecimento (Μέδια) | Sichern Heizleistung (mittel) | Δημιουργία αντιγράφων ασφαλείας ικανότητα θέρμανσης (μέση εποχή) |
| O | Capacidade declarada (Μέδια) | Angegebene Leistung (mittel) | Δηλωμένη ψυκτική ισχύς (μέση εποχή) |
| P | Outras estações de aquecimento adequadas para utilização | Weitere geeignete Heizperioden | Άλλες εποχές θέρμανσης που είναι κατάλληλο για χρήση |
| Q | SCOP (Mais quente) | SCOP (wärmer) | SCOP (μέση εποχή) |
| R | Classe de eficiência energética SCOP (Mais quente) | Energieeffizienzklasse SCOP (wärmer) | Τάξη ενεργειακής απόδοσης SCOP (μέση εποχή) |
| S | Q _{HE} ³⁾ estação de aquecimento (Mais quente) | Q _{HE} ³⁾ Heizperiode (wärmer) | Q _{HE} ³⁾ εποχή θέρμανσης (μέση εποχή) |
| T | Pdesignh (Mais quente) | Pdesignh (wärmer) | Pdesignh (θερμότερη εποχή) |
| U | Fazer backup de capacidade de aquecimento (Mais quente) | Sichern Heizleistung (wärmer) | Δημιουργία αντιγράφων ασφαλείας ικανότητα θέρμανσης (θερμότερη εποχή) |
| V | Capacidade declarada (Mais quente) | Angegebene Leistung (wärmer) | Δηλωμένη ψυκτική ισχύς (θερμότερη εποχή) |
| W | SCOP (Mais fria) | SCOP (kälter) | SCOP (μέση εποχή) |
| X | Classe de eficiência energética SCOP (Mais fria) | Energieeffizienzklasse SCOP (mittel) | Τάξη ενεργειακής απόδοσης SCOP (μέση εποχή) |
| Y | Q _{HE} ³⁾ estação de aquecimento (Mais fria) | Q _{HE} ³⁾ Heizperiode (mittel) | Q _{HE} ³⁾ εποχή θέρμανσης (μέση εποχή) |
| Z | Pdesignh (Mais fria) | Pdesignh (kälter) | Pdesignh (ψυχρότερη εποχή) |
| AA | Fazer backup de capacidade de aquecimento (Mais fria) | Sichern Heizleistung (kälter) | Δημιουργία αντιγράφων ασφαλείας ικανότητα θέρμανσης (ψυχρότερη εποχή) |
| AB | Capacidade declarada (Mais fria) | Angegebene Leistung (kälter) | Δηλωμένη ψυκτική ισχύς (ψυχρότερη εποχή) |

| | [Dutch-NL] | [Polish-PL] | [Hungarian-HU] |
|-----|--|---|--|
| i | COMMISSIE GEDELEGEERDE VERORDENING (EU) Nr. 626/2011 | ROZPORZĄDZENIE DELEGOWANE KOMISJI (UE) NR 626/2011 | 626/2011 BIZOTTSÁGI FELHATALMAZÁSON ALAPULÓ RENDELET (EU) |
| ii | PRODUCTKAART (ENERGIELABEL VOOR AIRCONDITIONERS) | KARTA PRODUKTU (OZNACZENIE KLIMATYZATORÓW ODNOSZĄCE SIĘ DO ICH ZUŻYCIA ENERGII) | TERMÉK ADATLAP (LÉGKONDITIONÁLÓK ENERGIHATÉKONYSÁGI CÍMKÉZÉSE) |
| iii | kWh/a | kWh/a | kWh/a |
| iv | - | - | - |
| A | Naam van de leverancier | Nazwa dostawcy | Forgalmazó neve |
| B | Modelnaam (binnen/buiten) | Nazwa modelu (Wewnętrzny/zewnętrzny) | Modellnév (Beltéri/kültéri) |
| C | Geluidsniveau (binnen/buiten) | Poziom mocy akustycznej (Wewnętrzna/zewnętrzna) | Zajszint (Beltéri/kültéri) |
| D | Koelmiddel ¹⁾ | Nazwa środka chłodzącego ¹⁾ | Hűtőközeg neve ¹⁾ |
| E | GWP | GWP | GWP |
| F | SEER | SEER | SEER |
| G | Energie-efficiencyklasse (SEER) | Klasa energetyczna (SEER) | Energiahatékonysági osztály (SEER) |
| H | $Q_{CE}^{2)}$ (koelingsseizoen) | $Q_{CE}^{2)}$ (okres chłodzenia) | $Q_{CE}^{2)}$ (hűtési szezon) |
| I | Pdesignc | Pdesignc | Pdesignc |
| J | SCOP (gemiddeld) | SCOP (średnie) | SCOP (átlagos) |
| K | Energie-efficiencyklasse SCOP (gemiddeld) | Klasa energetyczna SCOP (średnie) | Energiahatékonysági osztály SCOP (átlagos) |
| L | $Q_{HE}^{3)}$ verwarmingsseizoen (gemiddeld) | $Q_{HE}^{3)}$ okres grzewczy (średnie) | $Q_{HE}^{3)}$ fűtési szezon (átlagos) |
| M | Pdesignh (gemiddeld) | Deklarowane obciążenie grzewcze (średnie) | Pdesignh (átlagos) |
| N | Verwarmingsovercapaciteit (gemiddeld) | Wydajność rezerwowego podgrzewacza elektrycznego (średnia) | Biztonsági fűtőtéljesítmény (átlagos) |
| O | Opgegeven capaciteit (gemiddeld) | Deklarowana wydajność (średnia) | Névleges teljesítmény (átlagos) |
| P | Andere verwarmingsseizoenen geschikt voor gebruik | Inne okresy grzania odpowiednie do użytku | Egyéb fűtési szezonban használható |
| Q | SCOP (warmer) | SCOP (cieplej) | SCOP (melegebb) |
| R | Energie-efficiencyklasse SCOP (warmer) | Klasa energetyczna SCOP (cieplej) | Energiahatékonysági osztály SCOP (melegebb) |
| S | $Q_{HE}^{3)}$ verwarmingsseizoen (warmer) | $Q_{HE}^{3)}$ okres grzewczy (cieplej) | $Q_{HE}^{3)}$ fűtési szezon (melegebb) |
| T | Pdesignh (warmer) | Deklarowane obciążenie grzewcze (cieplej) | Pdesignh (melegebb) |
| U | Verwarmingsovercapaciteit (warmer) | Wydajność rezerwowego podgrzewacza (cieplej) | Biztonsági fűtőtéljesítmény (melegebb) |
| V | Opgegeven capaciteit (warmer) | Deklarowana wydajność (cieplej) | Névleges teljesítmény (melegebb) |
| W | SCOP (kouder) | SCOP (zimniej) | SCOP (hidegebb) |
| X | Energie-efficiencyklasse SCOP (kouder) | Klasa energetyczna SCOP (zimniej) | Energiahatékonysági osztály SCOP (hidegebb) |
| Y | $Q_{HE}^{3)}$ verwarmingsseizoen (kouder) | $Q_{HE}^{3)}$ okres grzewczy (zimniej) | $Q_{HE}^{3)}$ fűtési szezon (hidegebb) |
| Z | Pdesignh (kouder) | Deklarowane obciążenie grzewcze (zimniej) | Pdesignh (hidegebb) |
| AA | Verwarmingsovercapaciteit (kouder) | Wydajność rezerwowego podgrzewacza (zimniej) | Biztonsági fűtőtéljesítmény (hidegebb) |
| AB | Opgegeven capaciteit (kouder) | Deklarowana wydajność (zimniej) | Névleges teljesítmény (hidegebb) |

Appendix

| | [Czech-CS] | [Slovak-SK] | [Romanian-RO] |
|-----|--|---|--|
| i | NARIŽENÍ KOMISE V PŘENESENÉ PRAVOMOCI (EU) Č. 626/2011 | DELEGOVANÉ NARIADENIE KOMISIE (EÚ) č. 626/2011 | REGULAMENTUL DELEGAT (UE) 626/2011 AL COMISIEI |
| ii | LIST VÝROBKU (ENERGETICKÉ ŠTÍTKY KLIMATIZACÍ) | Opis výrobku (označovanie klimatizátorov energetickými) | FIȘA PRODUSULUI (ETICHETAREA ENERGETICĂ A APARATELOR DE AER CONDIȚIONAT) |
| iii | kWh/a | kWh/rok | kWh/a |
| iv | - | - | - |
| A | Název dodavatele | Název dodávateľa | Numele furnizorului |
| B | Název modelu (vnitřní/venkovní) | Název modelu(vnútorné/vonkajšie) | Numele modelului (interior/exterior) |
| C | Hladina akustického výkonu (vnitřní/venkovní) | Hladina akustického výkonu (vnútorná/vonkajšia) | Nivel de putere acustică (interior/exterior) |
| D | Název chladiva ¹⁾ | Chladivo ¹⁾ | Numele agentului frigorific ¹⁾ |
| E | GWP | GWP | GWP |
| F | SEER | SEER | SEER |
| G | Třída energetické účinnosti (SEER) | Trieda energetickej účinnosti (SEER) | Clasă de eficiență energetică (SEER) |
| H | Q _{CE} ²⁾ (období chlazení) | Q _{CE} ²⁾ (sezóna chladenia) | Q _{CE} ²⁾ (perioadă de răcire) |
| I | Pdesignc | Pdesignc | Pdesignc |
| J | SCOP (průměr) | SCOP (Priemerná) | SCOP (mediu) |
| K | Třída energetické účinnosti SCOP (průměrný) | Trieda energetickej účinnosti SCOP (Priemerná) | Clasă de eficiență energetică SCOP (mediu) |
| L | Q _{HE} ³⁾ období topení (průměrný) | Q _{HE} ³⁾ sezóna vykurovania (Priemerná) | Q _{HE} ³⁾ perioadă de încălzire (mediu) |
| M | Pdesignh (průměr) | Pdesignh (Priemerná) | Pdesignh (mediu) |
| N | Záložní topný výkon (průměrný) | Zálohovanie vykurovací výkon (Priemerná) | Capacitate de încălzire de rezervă (medie) |
| O | Udávaný výkon (průměrný) | Deklarovaný chladiaci výkon (Priemerná) | Capacitate declarată (medie) |
| P | Další topné sezony vhodné k použití | Iné sezóny vykurovania, v ktorých je vhodné použitie zariadenia | Alte perioade de încălzire adecvate pentru utilizare |
| Q | SCOP (teplejší) | SCOP (Teplejšia) | SCOP (mai cald) |
| R | Třída energetické účinnosti SCOP (teplejší) | Trieda energetickej účinnosti SCOP (Teplejšia) | Clasă de eficiență energetică SCOP (mai cald) |
| S | Q _{HE} ³⁾ období topení (teplejší) | Q _{HE} ³⁾ sezóna vykurovania (Teplejšia) | Q _{HE} ³⁾ perioadă de încălzire (mai cald) |
| T | Pdesignh (teplejší) | Pdesignh (Teplejšia) | Pdesignh (mai cald) |
| U | Záložní topný výkon (teplejší) | Zálohovanie vykurovací výkon (Teplejšia) | Capacitate de încălzire de rezervă (mai cald) |
| V | Udávaný výkon (teplejší) | Deklarovaný chladiaci výkon (Teplejšia) | Capacitate declarată (mai cald) |
| W | SCOP (chladnější) | SCOP (Chladnejšia) | SCOP (mai rece) |
| X | Třída energetické účinnosti SCOP (chladnější) | Trieda energetickej účinnosti SCOP (Chladnejšia) | Clasă de eficiență energetică SCOP (mai rece) |
| Y | Q _{HE} ³⁾ období topení (chladnější) | Q _{HE} ³⁾ sezóna vykurovania (Chladnejšia) | Q _{HE} ³⁾ perioadă de încălzire (mai rece) |
| Z | Pdesignh (chladnější) | Pdesignh (Chladnejšia) | Pdesignh (mai rece) |
| AA | Záložní topný výkon (chladnější) | Zálohovanie vykurovací výkon (Chladnejšia) | Capacitate de încălzire de rezervă (mai rece) |
| AB | Udávaný výkon (chladnější) | Deklarovaný chladiaci výkon (Chladnejšia) | Capacitate declarată (mai rece) |

| | [Bulgarian-BG] | [Croatian-HR] | [Slovenian-SL] |
|-----|---|---|---|
| i | ДЕЛЕГИРАН РЕГЛАМЕНТ (ЕС) № 626/2011 НА КОМИСИЯТА | DELEGIрана UREDBA KOMISIJE (EU) br. 626/2011 | DELEGOVANÉ NARIADENIE KOMISIE (EÚ) č. 626/2011 |
| ii | ПРОДУКТОВ ФИШ (ЕНЕРГИЙНО ЕТИКЕТИРАНЕ НА КЛИМАТИЦИ) | Informacijski list proizvoda (označavanja energetske učinkovitosti) | Opis výrobku (označovanie klimatizátorov energetickými) |
| iii | kWh/a | kWh/a | kWh/rok |
| iv | - | - | - |
| A | Име на доставчик | Naziv dobavljača | Názov dodávateľa |
| B | Име на модел (вътрешно/външно тяло) | Naziv modela (unutarnji/spoljni) | Názov modelu (vnútorné/vonkajšie) |
| C | Ниво на акустична мощност (вътрешно/външно тяло) | Razina zvučne snage (u zatvorenom/otvorenom) | Hladina akustického výkonu (vnútorná/vonkajšia) |
| D | Име на хладилен агент ¹⁾ | Naziv rashladnog sredstva ¹⁾ | Chladivo ¹⁾ |
| E | GWP | GWP | GWP |
| F | SEER | SEER | SEER |
| G | Клас на енергийна ефективност (SEER) | Razred energetske učinkovitosti (SEER) | Trieda energetickej účinnosti (SEER) |
| H | Q _{CE} ²⁾ (сезон на охлаждане) | Q _{CE} ²⁾ (sezona hlađenja) | Q _{CE} ²⁾ (sezóna chladenia) |
| I | Pdesignc | Pdesignc | Pdesignc |
| J | SCOP (среден) | SCOP (Prosječno) | SCOP (Priemerná) |
| K | Клас на енергийна ефективност SCOP (среден) | Razred energetske učinkovitosti SCOP (Prosječno) | Trieda energetickej účinnosti SCOP (Priemerná) |
| L | Q _{HE} ³⁾ сезон на отопление (среден) | Q _{HE} ³⁾ sezona grijanja (Prosječno) | Q _{HE} ³⁾ sezóna vykurovania (Priemerná) |
| M | Обявен отоплителен товар (среден) | Pdesignh (Prosječno) | Pdesignh (Priemerná) |
| N | Капацитет на помощно отопление (среден) | Back up kapacitet grijanja (Prosječno) | Zálohovanie vykurovací výkon (Priemerná) |
| O | Деклариран капацитет (среден) | Prijavljeni kapacitet (Prosječno) | Deklarovaný chladiaci výkon (Priemerná) |
| P | Други сезони на отопление, подходящи за използване | Druge sezone grijanja u kojima se može koristiti | Iné sezóny vykurovania, v ktorých je vhodné použitie zariadenia |
| Q | SCOP (по-топло) | SCOP (Toplije) | SCOP (Teplejšia) |
| R | Клас на енергийна ефективност SCOP (по-топло) | Razred energetske učinkovitosti SCOP (Toplije) | Trieda energetickej účinnosti SCOP (Teplejšia) |
| S | Q _{HE} ³⁾ сезон на отопление (по-топло) | Q _{HE} ³⁾ sezona grijanja (Toplije) | Q _{HE} ³⁾ sezóna vykurovania (Teplejšia) |
| T | Обявен отоплителен товар (по-топло) | Pdesignh (Toplije) | Pdesignh (Teplejšia) |
| U | Капацитет на помощно отопление (по-топло) | Back up kapacitet grijanja (Toplije) | Zálohovanie vykurovací výkon (Teplejšia) |
| V | Деклариран капацитет (по-топло) | Prijavljeni kapacitet (Toplije) | Deklarovaný chladiaci výkon (Teplejšia) |
| W | SCOP (по-студено) | SCOP (Hladnije) | SCOP (Chladnejšia) |
| X | Клас на енергийна ефективност SCOP (по-студено) | Razred energetske učinkovitosti SCOP (Hladnije) | Trieda energetickej účinnosti SCOP (Chladnejšia) |
| Y | Q _{HE} ³⁾ сезон на отопление (по-студено) | Q _{HE} ³⁾ sezona grijanja (Hladnije) | Q _{HE} ³⁾ sezóna vykurovania (Chladnejšia) |
| Z | Обявен отоплителен товар (по-студено) | Pdesignh (Hladnije) | Pdesignh (Chladnejšia) |
| AA | Капацитет на помощно отопление (по-студено) | Back up kapacitet grijanja (Hladnije) | Zálohovanie vykurovací výkon (Chladnejšia) |
| AB | Деклариран капацитет (по-студено) | Prijavljeni kapacitet (Hladnije) | Deklarovaný chladiaci výkon (Chladnejšia) |

Appendix

| | [Danish-DA] | [Swedish-SV] | [Finnish-FI] |
|-----|--|--|--|
| i | KOMMISSIONENS DELEGEREDE FÖRORDNING (EU) nr. 626/2011 | KOMMISSIONENS DELEGERADE FÖRORDNING (EU) nr 626/2011 | DELEGOITU KOMISSIO ASETUS (EU) N:o 626/2011 |
| ii | DATABLAD (ENERGIMÆRKNING AF KLIMAANLÆG) | INFORMATIONSBLAG OM PRODUKTEN (ENERGIMÄRKNING AV LUFTKONDITIONERINGSAPPARATER) | DELEGOITU KOMISSIO ASETUS (EU) N:o 626/2011 |
| iii | kWh pr. år | kWh/år | kWh/a |
| iv | - | - | - |
| A | Leverandørens navn | Leverantörens namn | Tavarantoimittajan nimi |
| B | Modelnavn (indendørs/udendørs) | Modellnamn (inomhus/utomhus) | Mallin nimi (sisä/ulko) |
| C | Lydeffektniveau (indenfor/udenfor) | Ljudnivå (inomhus/utomhus) | Äänitehotaso (sisä/ulko) |
| D | Navnet på køleelementet ¹⁾ | Köldmedium ¹⁾ | Kylmääineen nimi ¹⁾ |
| E | GWP | GWP | GWP |
| F | SEER | SEER | SEER |
| G | Energieffektivitetsklasse (SEER) | Energieffektivitetsklass (SEER) | Energiatohokkuusluokka (SEER) |
| H | Q _{CE} ²⁾ (kølesæson) | Q _{CE} ²⁾ (kylningssäsong) | Q _{CE} ²⁾ (jäähdytyskausi) |
| I | Pdesignc | Pdesignc | Pdesignc |
| J | SCOP (gennemsnitlig) | SCOP (genomsnitt) | SCOP (keskimääräinen) |
| K | Energieffektivitetsklasse SCOP (gennemsnitlig) | Energieffektivitetsklass SCOP (genomsnitt) | Energiatohokkuusluokka SCOP (keskimääräinen) |
| L | Q _{HE} ³⁾ varmesæson (gennemsnitlig) | Q _{HE} ³⁾ oppvärmningssäsong (genomsnitt) | Q _{HE} ³⁾ lämmityskausi (keskimääräinen) |
| M | Pdesignh (gennemsnitlig) | Pdesignh (genomsnitt) | Pdesignh (keskimääräinen) |
| N | Backup-varmekapacitet (gennemsnitlig) | Backup-varmekapacitet (genomsnitt) | Varalämmitysteho (keskimääräinen) |
| O | Deklareret kapacitet (gennemsnitlig) | Deklarerad kapacitet (genomsnitt) | Ilmoitettu teho (keskimääräinen) |
| P | Andre opvarmningsæsoner, der er beregnet til brug | Andra passande oppvärmningssäsonger | Muut käytettävät lämmityskaudet |
| Q | SCOP (varmere) | SCOP (varmare) | SCOP (lämmin) |
| R | Energieffektivitetsklasse SCOP (varmere) | Energieffektivitetsklass SCOP (varmare) | Energiatohokkuusluokka SCOP (lämmin) |
| S | Q _{HE} ³⁾ varmesæson (varmere) | Q _{HE} ³⁾ oppvärmningssäsong (varmare) | Q _{HE} ³⁾ lämmityskausi (lämmin) |
| T | Pdesignh (varmere) | Pdesignh (varmare) | Pdesignh (lämmin) |
| U | Backup-varmekapacitet (varmere) | Backup-varmekapacitet (varmare) | Varalämmitysteho (lämmin) |
| V | Deklareret kapacitet (varmere) | Deklarerad kapacitet (varmare) | Ilmoitettu teho (lämmin) |
| W | SCOP (koldere) | SCOP (kallare) | SCOP (kylmä) |
| X | Energieffektivitetsklasse SCOP (koldere) | Energieffektivitetsklass SCOP (kallare) | Energiatohokkuusluokka SCOP (kylmä) |
| Y | Q _{HE} ³⁾ varmesæson (koldere) | Q _{HE} ³⁾ oppvärmningssäsong (kallare) | Q _{HE} ³⁾ lämmityskausi (kylmä) |
| Z | Pdesignh (koldere) | Pdesignh (kallare) | Pdesignh (kylmä) |
| AA | Backup-varmekapacitet (koldere) | Backup-varmekapacitet (kallare) | Varalämmitysteho (kylmä) |
| AB | Deklareret kapacitet (koldere) | Deklarerad kapacitet (kallare) | Ilmoitettu teho (kylmä) |

| | [Estonian-ET] | [Latvian-LV] | [Lithuanian-LT] |
|-----|---|--|---|
| i | KOMISJONI DELEGEERITUD MÄÄRUS (EL) nr 626/2011 | KOMISIJAS DELEĢĒTĀ REGULA (ES) NR. 626/2011 | KOMISIJOS DELEGUOTASIS REGLAMENTAS (ES) Nr. 626/2011 |
| ii | TOOTEKAART (ÕHUKONDISIOONEERIDE ENERGIAMÄRGISTUS) | DATU LAPA (GAISA KONDICIONĒTĀJU ENERGMARKĒJUMS) | GAMINIO MIKROKORTA (ORO KONDICIONIERIŲ ENERGIJOS SUVARTOJIMO ŽENKLINIMAS) |
| iii | kWh/a | kWh/a | kWh/a |
| iv | - | - | - |
| A | Tarnija nimi | Piegādātāja nosaukums | Tieķejo pavadinimas |
| B | Mudeli nimi (sisetingimused/välistingimused) | Modeļa nosaukums (iekštelpu/ārtelpu) | Modelio pavadinimas (naudojamo patalpose / lauke) |
| C | Helivõimsuse tase (sisetingimused/välistingimused) | Skaņas intensitātes līmenis (iekštelpu/ārtelpu) | Garso galios lygis (patalpose / lauke) |
| D | Jahutusaine nimi ¹⁾ | Aukstumaģenta nosaukums ¹⁾ | Šaldalo pavadinimas ¹⁾ |
| E | GWP | GWP | GWP |
| F | SEER | SEER | SEER |
| G | Energiatõhususe klass (SEER) | Energoefektivitātes klase (SEER) | Enerģijos suvartojimo efektyvumo klasė (SEER) |
| H | Q _{CE} ²⁾ (jahutamishooaeg) | Q _{CE} ²⁾ (dzesēšanas sezonā) | Q _{CE} ²⁾ (vēsinimo sezonas) |
| I | Pdesignc | Pdesignc | Pdesignc |
| J | SCOP (keskmīne) | SCOP (vidējā) | SCOP (vidutinis klimatas) |
| K | Energiatõhususe klass SCOP (keskmīne) | Energoefektivitātes klase SCOP (vidējā) | Enerģijos suvartojimo efektyvumo klasė SCOP (vidutinis klimatas) |
| L | Q _{HE} ³⁾ kŭtmishooaeg (keskmīne) | Q _{HE} ³⁾ sildīšanas sezonā (vidējā) | Q _{HE} ³⁾ šildymo sezonas (vidutinis klimatas) |
| M | Pdesignh (keskmīne) | Deklarētā sildīšanas slodze (vidējā) | Projektinė aprova šildymo režimu (Pdesignh) (vidutinis klimatas) |
| N | Varukŭtte võimsus (keskmīne) | Rezerves sildīšanas jauda (vidējā) | Atsarginis šildymo pajėgumas (vidutinis klimatas) |
| O | Mārgitud võimsus (keskmīne) | Deklarētā jauda (vidējā) | Projektinis pajėgumas (vidutinis klimatas) |
| P | Muud sobivad kŭtmishooajad | Citas sildīšanas sezonas, kas piemērotas lietošanai | Kiti šildymo sezonai, kurias tinkama naudoti |
| Q | SCOP (soojem) | SCOP (siltākā) | SCOP (šiltensnis klimatas) |
| R | Energiatõhususe klass SCOP (soojem) | Energoefektivitātes klase SCOP (siltākā) | Enerģijos suvartojimo efektyvumo klasė SCOP (šiltensnis klimatas) |
| S | Q _{HE} ³⁾ kŭtmishooaeg (soojem) | Q _{HE} ³⁾ sildīšanas sezonā (siltākā) | Q _{HE} ³⁾ šildymo sezonas (šiltensnis klimatas) |
| T | Pdesignh (soojem) | Deklarētā sildīšanas slodze (siltākā) | Projektinė aprova šildymo režimu (Pdesignh) (šiltensnis klimatas) |
| U | Varukŭtte võimsus (soojem) | Rezerves sildīšanas jauda (siltākā) | Atsarginis šildymo pajėgumas (šiltensnis klimatas) |
| V | Mārgitud võimsus (soojem) | Deklarētā jauda (siltākā) | Projektinis pajėgumas (šiltensnis klimatas) |
| W | SCOP (kŭlmem) | SCOP (aukstākā) | SCOP (šaltensnis klimatas) |
| X | Energiatõhususe klass SCOP (kŭlmem) | Energoefektivitātes klase SCOP (aukstākā) | Enerģijos suvartojimo efektyvumo klasė SCOP (šaltensnis klimatas) |
| Y | Q _{HE} ³⁾ kŭtmishooaeg (kŭlmem) | Q _{HE} ³⁾ sildīšanas sezonā (aukstākā) | Q _{HE} ³⁾ šildymo sezonas (šaltensnis klimatas) |
| Z | Pdesignh (kŭlmem) | Deklarētā sildīšanas slodze (aukstākā) | Projektinė aprova šildymo režimu (Pdesignh) (šaltensnis klimatas) |
| AA | Varukŭtte võimsus (kŭlmem) | Rezerves sildīšanas jauda (aukstākā) | Atsarginis šildymo pajėgumas (šaltensnis klimatas) |
| AB | Mārgitud võimsus (kŭlmem) | Deklarētā jauda (aukstākā) | Projektinis pajėgumas (šaltensnis klimatas) |

Appendix

| [Serbian-SR] | |
|--------------|---|
| i | КОМИСИЈА ДЕЛЕГАТЕД УРЕДБА (ЕС) № 626/2011 |
| ii | ПРОИЗВОДА ФИЦХЕ (енергетског означавања клима уређаја) |
| iii | kWh/godišnje |
| iv | - |
| A | Naziv dobavljača |
| B | Naziv modela (unutrašnja jedinica/spoljašnja jedinica) |
| C | Nivo buke (unutrašnja/spoljna jedinica) |
| D | Naziv rashladnog sredstva ¹⁾ |
| E | GWP |
| F | SEER |
| G | Klasa energetske efikasnosti (SEER) |
| H | $Q_{CE}^{2)}$ (sezona hlađenja) |
| I | Pdesignc |
| J | SCOP (Prosečno) |
| K | Klasa energetske efikasnosti SCOP (Prosečno) |
| L | $Q_{HE}^{3)}$ grejna sezona (Prosečno) |
| M | Pdesignh (Prosečno) |
| N | Бацк ул капацитет грејања (Prosečno) |
| O | Deklarisani kapacitet (Prosečno) |
| P | Druge grejne sezone pogodne za korišćenje |
| Q | SCOP (Topliji deo godine) |
| R | Klasa energetske efikasnosti SCOP (Topliji deo godine) |
| S | $Q_{HE}^{3)}$ grejna sezona (Topliji deo godine) |
| T | Pdesignh (Topliji deo godine) |
| U | Бацк ул капацитет грејања (Topliji deo godine) |
| V | Deklarisani kapacitet (Topliji deo godine) |
| W | SCOP (Hladniji deo godine) |
| X | Klasa energetske efikasnosti SCOP (Hladniji deo godine) |
| Y | $Q_{HE}^{3)}$ grejna sezona (Hladniji deo godine) |
| Z | Pdesignh (Hladniji deo godine) |
| AA | Бацк ул капацитет грејања (Hladniji deo godine) |
| AB | Deklarisani kapacitet (Hladniji deo godine) |

[Spanish-ES]

- 1 Las fugas de refrigerante contribuyen al cambio climático. Cuanto mayor sea el potencial de calentamiento global (GWP) de un refrigerante, más contribuirá a dicho calentamiento su vertido a la atmósfera. Este aparato contiene un líquido refrigerante con un GWP igual a [675]. Esto significa que, si pasara a la atmósfera 1 kg de este líquido refrigerante, el impacto en el calentamiento global sería, a lo largo de un periodo de 100 años, [675] veces mayor que si se vertiera 1 kg de CO₂. Nunca intente intervenir en el circuito del refrigerante ni desmontar el aparato usted mismo; consulte siempre a un profesional.
- 2 Consumo de energía "XYZ" kWh/año, según los resultados obtenidos en ensayos estándar. El consumo de energía real depende de las condiciones de uso del aparato y del lugar en el que esté instalado.
- 3 Consumo de energía "XYZ" kWh/año, según los resultados obtenidos en ensayos estándar. El consumo de energía real depende de las condiciones de uso del aparato y del lugar en el que esté instalado.

[French-FR]

- 1 Les fuites de réfrigérants accentuent le changement climatique. En cas de fuite, l'impact sur le réchauffement de la planète sera d'autant plus limité que le potentiel de réchauffement planétaire (PRP) du réfrigérant est faible. Cet appareil utilise un réfrigérant dont le PRP est égal à [675]. En d'autres termes, si 1 kg de ce réfrigérant est relâché dans l'atmosphère, son impact sur le réchauffement de la planète sera [675] fois supérieur à celui d'1 kg de CO₂, sur une période de 100 ans. Ne tentez jamais d'intervenir dans le circuit frigorifique et de démonter les pièces vous-même et adressez-vous systématiquement à un professionnel.
- 2 Consommation d'énergie de "XYZ" kWh par an, déterminée sur la base des résultats obtenus dans des conditions d'essai normalisées. La consommation d'énergie réelle dépend des conditions d'utilisation et de l'emplacement de l'appareil.
- 3 Consommation d'énergie de "XYZ" kWh par an, déterminée sur la base des résultats obtenus dans des conditions d'essai normalisées. La consommation d'énergie réelle dépend des conditions d'utilisation et de l'emplacement de l'appareil.

[Italian-IT]

- 1 La perdita di refrigerante contribuisce al cambiamento climatico. In caso di rilascio nell'atmosfera, i refrigeranti con un potenziale di riscaldamento globale (GWP) più basso contribuiscono in misura minore al riscaldamento globale rispetto a quelli con un GWP più elevato. Questo apparecchio contiene un fluido refrigerante con un GWP di [675]. Se 1 kg di questo fluido refrigerante fosse rilasciato nell'atmosfera, quindi, l'impatto sul riscaldamento globale sarebbe [675] volte più elevato rispetto a 1 kg di CO₂, per un periodo di 100 anni. In nessun caso l'utente deve cercare di intervenire sul circuito refrigerante o di disassemblare il prodotto. In caso di necessità occorre sempre rivolgersi a personale qualificato.
- 2 Consumo di energia "XYZ" kWh/anno in base ai risultati di prove standard. Il consumo effettivo dipende dalle modalità di utilizzo dell'apparecchio e dal luogo in cui è installato.
- 3 Consumo di energia "XYZ" kWh/anno in base ai risultati di prove standard. Il consumo effettivo dipende dalle modalità di utilizzo dell'apparecchio e dal luogo in cui è installato.

[Portuguese-PT]

- 1 A fuga de fluido refrigerante contribui para as alterações climáticas. Os fluidos refrigerantes com menor potencial de aquecimento global (PAG) contribuem menos para o aquecimento global do que os fluidos refrigerantes com maior PAG, em caso de fuga para a atmosfera. Este aparelho contém um fluido refrigerante com um PAG igual a [675]. Isto significa que, se ocorrer uma fuga de 1 kg deste fluido refrigerante para a atmosfera, o seu impacto no aquecimento global será [675] vezes mais elevado do que o de 1 kg de CO₂, durante um período de 100 anos. Nunca tome a iniciativa de intervir no circuito do fluido refrigerante ou de desmontar este produto; recorra sempre a um profissional.
- 2 Consumo de energia "XYZ" kWh por ano, com base nos resultados do teste normalizado. O valor real do consumo de energia dependerá do modo de utilização do aparelho e da sua localização.
- 3 Consumo de energia "XYZ" kWh por ano, com base nos resultados do teste normalizado. O valor real do consumo de energia dependerá do modo de utilização do aparelho e da sua localização.

Appendix

[German-DE]

- 1 Der Austritt von Kältemittel trägt zum Klimawandel bei. Kältemittel mit geringerem Treibhauspotenzial tragen im Fall eines Austretens weniger zur Erderwärmung bei als solche mit höherem Treibhauspotenzial. Dieses Gerät enthält Kältemittel mit einem Treibhauspotenzial von [675]. Somit hätte ein Austreten von 1 kg dieses Kältemittels [675] Mal größere Auswirkungen auf die Erderwärmung als 1 kg CO₂, bezogen auf hundert Jahre. Keine Arbeiten am Kältekreislauf vornehmen oder das Gerät zerlegen – stets Fachpersonal hinzuziehen.
- 2 Energieverbrauch „XYZ“ kWh/Jahr, auf der Grundlage von Ergebnissen der Normprüfung. Der tatsächliche Verbrauch hängt von der Nutzung und vom Standort des Geräts ab.
- 3 Energieverbrauch „XYZ“ kWh/Jahr, auf der Grundlage von Ergebnissen der Normprüfung. Der tatsächliche Verbrauch hängt von der Nutzung und vom Standort des Geräts ab.

[Greek-EL]

- 1 Διαρροή ψυκτικού μέσου συμβάλλει στην κλιματική αλλαγή. Εάν διαρρεύσει στην ατμόσφαιρα ψυκτικό μέσο με χαμηλότερο δυναμικό θέρμανσης του πλανήτη (GWP) θα συμβάλει λιγότερο στην υπερθέρμανση του πλανήτη από ψυκτικό με υψηλότερο GWP. Αυτή η συσκευή περιέχει ψυκτικό μέσο με GWP ίσο με [675]. Αυτό σημαίνει ότι εάν διαρρεύσει στην ατμόσφαιρα 1 kg του ψυκτικού μέσου, οι επιπτώσεις στην υπερθέρμανση του πλανήτη θα είναι [675] φορές μεγαλύτερες από 1 kg CO₂, σε περίοδο 100 ετών. Ποτέ μην επιχειρήσετε να επέμβετε στο κύκλωμα ψυκτικού μέσου ή να αποσυναρμολογήσετε το προϊόν και πάντοτε να απευθύνεστε σε επαγγελματία.
- 2 Κατανάλωση ενέργειας „XYZ“ kWh ετησίως, με βάση τα αποτελέσματα πρότυπης δοκιμής. Η πραγματική κατανάλωση ενέργειας εξαρτάται από τον τρόπο χρήσης και τη θέση της συσκευής.
- 3 Κατανάλωση ενέργειας „XYZ“ kWh ετησίως, με βάση τα αποτελέσματα πρότυπης δοκιμής. Η πραγματική κατανάλωση ενέργειας εξαρτάται από τον τρόπο χρήσης και τη θέση της συσκευής.

[Dutch-NL]

- 1 Lekkage van koelmiddel leidt tot klimaatverandering. Bij lekkage in de lucht draagt een koelmiddel met een laag aardopwarmingsvermogen (GWP) minder bij tot de opwarming van de aarde dan een koelmiddel met een hoog GWP. Dit apparaat bevat een koelmiddel met een GWP gelijk aan [675]. Dit houdt in dat als 1 kg van deze koelvloeistof in de lucht vrijkomt, het effect op de aardopwarming over een periode van 100 jaar [675] keer groter zou zijn dan bij het vrijkomen van 1 kg CO₂. Laat het koelcircuit steeds ongemoeid en probeer nooit het product zelf te demonteren; vraag dit steeds aan een vakman.
- 2 Energieverbruik „XYZ“ kWh per jaar, gebaseerd op de resultaten van standaardtests. Het feitelijke energieverbruik is afhankelijk van de manier waarop het apparaat wordt gebruikt en de plaats waar het zich bevindt.
- 3 Energieverbruik „XYZ“ kWh per jaar, gebaseerd op de resultaten van standaardtests. Het feitelijke energieverbruik is afhankelijk van de manier waarop het apparaat wordt gebruikt en de plaats waar het zich bevindt.

[Polish-PL]

- 1 Wyciek czynnika chłodniczego przyczyniają się do zmiany klimatu. W przypadku przedostania się do atmosfery czynnik chłodniczy o niższym współczynniku ocieplenia globalnego (GWP) ma mniejszy wpływ na globalne ocieplenie niż czynnik o wyższym współczynniku GWP. Urządzenie zawiera płyn chłodniczy o współczynniku GWP wynoszącym [675]. Powyższe oznacza, iż w przypadku przedostania się 1 kg takiego płynu chłodniczego do atmosfery, jego wpływ na globalne ocieplenie byłby [675] razy większy niż wpływ 1 kg CO₂ w okresie 100 lat. Nigdy nie należy samodzielnie manipulować przy obiegu czynnika chłodniczego lub demontować urządzenia, należy zawsze zwrócić się o pomoc specjalisty.
- 2 Zużycie energii elektrycznej »XYZ« kWh rocznie na podstawie wyników próby przeprowadzonej w normalnych warunkach. Rzeczywiste zużycie energii elektrycznej zależy od sposobu użytkowania urządzenia i miejsca, w którym się ono znajduje.
- 3 Zużycie energii elektrycznej »XYZ« kWh rocznie na podstawie wyników próby przeprowadzonej w normalnych warunkach. Rzeczywiste zużycie energii elektrycznej zależy od sposobu użytkowania urządzenia i miejsca, w którym się ono znajduje.

[Hungarian-HU]

- 1 A hűtőfolyadék szivárgása hozzájárul a globális felmelegedéshez. Minél kisebb egy hűtőfolyadék globális felmelegedési potenciálja (GWP-je), annál kevésbé járul hozzá a globális felmelegedéshez, ha a légkörbe kerül. A készülékben található hűtőfolyadék GWP-je [675]. Ez azt jelenti, hogy ha ebből a hűtőfolyadékból 1 kilogramm a légkörbe kerülne, akkor a globális felmelegedésre 100 év alatt [675]-szor/-szer/-ször akkora hatást gyakorolna, mint 1 kilogramm szén-dioxid. Ne próbáljon saját kezűleg beavatkozni a hűtőkörbé, és ne szedje szét saját kezűleg a terméket! Ezt a feladatot mindig bízza szakemberrel!
- 2 »XYZ« kWh/év energiafogyasztás szabványos vizsgálati eredmények alapján. A tényleges energiafogyasztás függ a készülék elhelyezésétől és használatának módjától.
- 3 »XYZ« kWh/év energiafogyasztás szabványos vizsgálati eredmények alapján. A tényleges energiafogyasztás függ a készülék elhelyezésétől és használatának módjától.

[Czech-CS]

- 1 Únik chladiva se podílí na změně klimatu. Chladivo s nižším potenciálem globálního oteplování (GWP) by se v případě úniku do ovzduší podílelo na globálním oteplování méně než chladivo s vyšším GWP. Toto zařízení obsahuje chladicí kapalinu s GWP ve výši [675]. To znamená, že pokud by do ovzduší unikl 1 kg této chladicí kapaliny, dopad na globální oteplování by byl v horizontu 100 let [675] krát vyšší než 1 kg CO₂. Nenarušujte chladicí oběh ani sami výrobek nedemontujte, vždy se obraťte na odborníka.
- 2 Spotřeba energie „XYZ“ kWh za rok, založená na výsledcích normalizované zkoušky. Skutečná spotřeba energie závisí na způsobu použití a umístění spotřebiče.
- 3 Spotřeba energie „XYZ“ kWh za rok, založená na výsledcích normalizované zkoušky. Skutečná spotřeba energie závisí na způsobu použití a umístění spotřebiče.

[Slovak-SK]

- 1 Úniky chladiva prispievajú k zmene klímy. Chladivo s nižším potenciálom prispievania ku globálnemu oteplovaniu (GWP) by pri úniku do atmosféry prispelo ku globálnemu oteplovaniu v nižšej miere ako chladivo s vyšším GWP. Toto zariadenie obsahuje chladiacu kvapalinu s GWP rovnajúcim sa [675]. Znamená to, že ak by do atmosféry unikol 1 kg tejto chladiacej kvapaliny, jej vplyv na globálne otepľovanie by bol [675] krát vyšší ako vplyv 1 kg CO₂, a to počas obdobia 100 rokov. Nikdy sa nepokúšajte zasahovať do chladiaceho okruhu alebo demontovať výrobok a vždy sa obráťte na odborníka.
- 2 Spotreba energie XYZ kWh za rok na základe výsledkov štandardného preskúšania. Skutočná spotreba energie bude závisieť od toho, ako sa zariadenie používa a kde je umiestnené.
- 3 Spotreba energie XYZ kWh za rok na základe výsledkov štandardného preskúšania. Skutočná spotreba energie bude závisieť od toho, ako sa zariadenie používa a kde je umiestnené.

[Romanian-RO]

- 1 Scurgerea de agent frigorific contribuie la schimbările climatice. Dacă s-ar scurge în atmosferă, agenții frigorifici cu un potențial de încălzire globală (GWP) mai redus ar contribui într-un mod mai puțin semnificativ la încălzirea globală decât un agent frigorific cu un GWP mai ridicat. Acest aparat conține un fluid refrigerant cu un GWP egal cu [675]. Aceasta înseamnă că, dacă 1 kg din acest fluid refrigerant s-ar scurge în atmosferă, impactul asupra încălzirii globale ar fi de [675] ori mai mare decât 1 kg de CO₂ pe o perioadă de 100 de ani. Nu încercați să interveniți în circuitul agentului frigorific sau să demontați singur produsul, apălați întotdeauna la un specialist.
- 2 Consum de energie de «XYZ» kWh pe an, pe baza rezultatelor testelor standard. Consumul real de energie va depinde de modul de utilizare a aparatului și de locul unde este amplasat.
- 3 Consum de energie de «XYZ» kWh pe an, pe baza rezultatelor testelor standard. Consumul de energie real depinde de condițiile de utilizare a aparatului și de locul unde este amplasat.

Appendix

[Bulgarian-BG]

- 1 Изпускането на хладилен агент допринася за изменението на климата. Хладилен агент с по-нисък потенциал за глобално затопляне (ПГЗ) би допринесъл по-малко за глобалното затопляне, отколкото хладилен агент с по-висок ПГЗ при евентуално изпускане в атмосферата. Настоящият уред съдържа хладилен агент с ПГЗ в размер на [675]. Това означава, че ако 1 kg от хладилния агент бъде изпуснат в атмосферата, въздействието за глобално затопляне ще бъде [675] пъти повече, отколкото от 1 kg CO₂ за период от 100 години. Никога не се опитвайте да се намесвате в работата на кръга на хладилния агент или сами да разглобявате уреда, а винаги се обръщайте към специалист.
- 2 XYZ[®] в kWh годишно, въз основа на резултати от стандартно изпитване. Действителната консумация на енергия ще зависи от това как се използва уредът и къде се намира той.
- 3 XYZ[®] в kWh годишно, въз основа на резултати от стандартно изпитване. Действителната консумация на енергия ще зависи от това как се използва уредът и къде се намира той.

[Croatian-HR]

- 1 Istjecanje rashladnih sredstava doprinosi klimatskim promjenama. U slučaju ispuštanja u atmosferu rashladno sredstvo s nižim potencijalom globalnog zagrijavanja (GWP) manje bi utjecalo na globalno zagrijavanje od rashladnog sredstva s višim GWP-om. Taj uređaj sadrži rashladnu tekućinu s GWP-om jednakim [675]. To znači da bi u slučaju istjecanja 1 kg te rashladne tekućine u atmosferu, njezin utjecaj na globalno zagrijavanje bio [675] puta veći od utjecaja 1 kg CO₂ tijekom razdoblja od 100 godina. Nikada sami ne pokušavajte raditi bilo kakve zahvate na rashladnom krugu niti rastavlјati proizvod i za to uvijek zovite profesionalca.
- 2 Potrošnja energije XYZ kWh na godinu, na temelju rezultata standardnih ispitivanja. Stvarna potrošnja energije ovisi o načinu uporabe uređaja i o mjestu na kojem se nalazi.
- 3 Potrošnja energije XYZ kWh na godinu, na temelju rezultata standardnih ispitivanja. Stvarna potrošnja energije ovisi o načinu uporabe uređaja i o mjestu na kojem se nalazi.

[Slovenian-SL]

- 1 Puščanje hladilnih sredstev prispeva k podnebnim spremembam. V primeru izpusta v ozračje bi hladilno sredstvo z nižjim potencialom globalnega segrevanja (GWP) k globalnemu segrevanju prispevalo manj kot hladilno sredstvo z višjim GWP. Ta naprava vsebuje hladilno tekočino z GWP, enakim [675]. To pomeni, da bi bil v obdobju 100 let vpliv na globalno segrevanje v primeru izpusta v ozračje 1 kg zadržane hladilne tekočine [675] večji od 1 kg CO₂. Nikoli ne poskušajte sami spremeniti hladilnega obtoka ali razstaviti naprave in za to vedno prosite strokovnjaka.
- 2 Letna poraba energije ,XYZ' kWh na leto na podlagi rezultatov standardnega preskusa. Dejanska poraba energije je odvisna od načina uporabe naprave in njene lokacije.
- 3 Letna poraba energije ,XYZ' kWh na leto na podlagi rezultatov standardnega preskusa. Dejanska poraba energije je odvisna od načina uporabe naprave in njene lokacije.

[Danish-DA]

- 1 Kølemiddeludslip medvirker til klimaforandringerne. Slipper kølemidlet ud i atmosfæren, bidrager det mindre til den globale opvarmning, hvis dets potentiale for global opvarmning (GWP) er lavt, end hvis det er højt. Dette apparat indeholder en kølevæske, hvis GWP-tal er [675]. Det betyder, at lækkes 1 kg af dette kølemiddel til atmosfæren, så vil det gennem en periode på 100 år bidrage [675] gange mere til den globale opvarmning end 1 kg CO₂. Prøv aldrig at pille ved kølemiddelkredslobet eller at skille produktet ad selv - overlad altid det til en fagmand.
- 2 Elforbrug »XYZ« kWh pr. år på grundlag af standardiserede prøvningsresultater. Det faktiske energiforbrug vil afhænge af, hvordan apparatet anvendes, og hvor det er placeret.
- 3 »Elforbrug »XYZ« kWh pr. år, på grundlag af standardiserede prøvningsresultater. Det faktiske energiforbrug vil afhænge af, hvordan apparatet anvendes, og hvor det er placeret.

[Swedish-SV]

- 1 Läckage av köldmedium bidrar till klimatförändringen. Köldmedium med lägre global uppvärmningspotential (GWP) skulle vid läckare ge upphov till mindre global uppvärmning än ett köldmedium med högre GWP. Den här apparaten innehåller ett köldmedium med GWP motsvarande [675]. Det betyder att om 1 kg av köldmediet skulle läcka ut i atmosfären, skulle påverkan på den globala uppvärmningen vara [675] gånger högre än 1 kg CO₂ under en hundraårsperiod. Försök aldrig själv montera isär produkten eller mixtra med köldmediekretsloppet. Rådfråga alltid en fackutbildad person.
- 2 Energiförbrukning 'XYZ' i kWh per år, baserat på resultat från standardiserade provningar. Den faktiska energiförbrukningen beror på hur apparaten används och var den placeras.
- 3 Energiförbrukning 'XYZ' i kWh per år, baserat på resultat från standardiserade provningar. Den verkliga energiförbrukningen beror på hur apparaten används och var den placeras.

[Finnish-FI]

- 1 Kylmäinevuodot vaikuttavat ilmastonmuutokseen. Kylmäaine, jolla on alaisempi ilmakehän lämmitysvaikutuspotentiaali (GWP), ilmastonmuutosvaikutus olisi pienempi kuin korkeamman GWP-arvon kylmäaineen, jos kylmäainetta pääsisi ilmakehään. Tämä laite sisältää kylmäainetta, jonka GWP-arvo on [675]. Tämä tarkoittaa, että jos yksi kilo tätä kylmäainetta pääsisi ilmakehään, sen vaikutus ilmaston lämpenemiseen olisi [675] kertaa suurempi kuin yhdellä kilolla hiili-dioksidia 100 vuoden ajanjaksolla. Älä koskaan yritä kajoa kylmäainepiiriin tai purkaa tuotetta omin päin, vaan pyydä aina ammattilaisen apua.
- 2 Energiankulutus 'XYZ' kWh vuodessa laskettuna vakio-olosuhteissa. Tosiasiallinen energiankulutus riippuu laitteen käyttötavoista ja laitteen sijaituksesta.
- 3 Energiankulutus 'XYZ' kWh vuodessa laskettuna vakio-olosuhteissa. Tosiasiallinen energiankulutus riippuu laitteen käyttötavoista ja laitteen sijaituksesta.

[Estonian-ET]

- 1 Külmutusaine leke hoogustab kliima soojenemist. Atmosfääri sattumisel annab madalama ülemaailmselt soojenemist põhjustava mõju (GWP) väärtusega külmutusaine väiksema panuse ülemaailmsesse kliimasoojenemisse kui kõrgema GWP väärtusega külmutusaine. Seade sisaldab külmutusvedelikku, mille GWP väärtus on [675]. See tähendab, et kui 1 kg seda külmutusvedelikku satub atmosfääri, annab see 100 aasta jooksul [675] korda suurema panuse ülemaailmsesse kliimasoojenemisse kui 1 kg CO₂. Ärge kunagi püüdkie ise muuta külmutusaine voolusüsteemi, samuti ärge püüdkie seadet ise koost lahti võtta, vaid pöörduge alati spetsialisti poole.
- 2 Energiatarbimine XYZ kilovatt-tundi aastas, põhineb standardtingimustes mõõdetud tulemustel. Tegelik energiatarbimine on leeb seadme kasutusviisist ja asukohast.
- 3 Energiatarbimine XYZ kilovatt-tundi aastas, põhineb standardtingimustes mõõdetud tulemustel. Tegelik energiatarbimine on leeb seadme kasutusviisist ja asukohast.

Appendix

[Latvian-LV]

- 1 Aukstumaģentu noplūdes veicina klimata pārmaiņas. Aukstumaģenta noplūdes gadījumā ierīces ar zemāku aukstumaģenta globālās sasilšanas potenciālu (GSP) nodara mazāku kaitējumu videi. Šajā ierīcē atrodas dzesēšanas šķidrums, kura globālās sasilšanas potenciāls GSP ir [675]. Tas nozīmē, ka, ja vidē nokļūst 1 kg šā dzesēšanas šķidruma, ietekme uz globālo sasilšanu 100 gadu laikā ir [675] reizes lielāka nekā 1 kg CO₂. Nekādā gadījumā neiejaucieties dzesēšanas ķēdes darbībā un nemēģiniet izjaukt ierīci. Vienmēr uzticiet to kvalificētam speciālistam.
- 2 Elektroenerģijas patēriņš "XYZ" kWh gadā, pamatojoties uz standarta testu rezultātiem. Faktiskais elektroenerģijas patēriņš atkarīgs no ierīces izmantošanas veida un atrašanās vietas.
- 3 Elektroenerģijas patēriņš "XYZ" kWh gadā, pamatojoties uz standarta testu rezultātiem. Faktiskais elektroenerģijas patēriņš atkarīgs no ierīces izmantošanas veida un atrašanās vietas.

[Lithuanian-LT]

- 1 Šaldalo nuotēkis prisideda prie klimato kaitos. Jei šaldalo nuotėkėtų į atmosferą, mažesnį visuotinio atšilimo potencialą turintis šaldalas mažiau prisidėtų prie visuotinio atšilimo negu didesnį visuotinio atšilimo potencialą turintis šaldalas. Šiame prietaise yra skysto šaldalo, kurio visuotinio atšilimo potencialas yra [675]. Tai reiškia, kad jei 1 kg šio šaldalo nuotėkėtų į atmosferą, poveikis visuotiniam atšilimui būtų [] kartų didesnis negu 1 kg CO₂ nuotėkio per 100 metų. Niekada nebandykite patys taisyti šaldalo kontūro ar išrinkti prietaiso. Visuomet kreipkitės į profesionalus.
- 2 Suvartojamos energijos kiekis – „XYZ“ kWh per metus, grindžiamas įprasto bandymo rezultatais. Faktinis suvartojamos energijos kiekis priklauso nuo to, kaip prietaisas naudojamas ir kur jis pastatytas.
- 3 Suvartojamos energijos kiekis – „XYZ“ kWh per metus, grindžiamas įprasto bandymo rezultatais. Faktinis suvartojamos energijos kiekis priklauso nuo to, kaip prietaisas naudojamas ir kur jis pastatytas.

[Serbian-SR]

- 1 Curenje rashladnog sredstva doprinosi klimatskim promenama. Ako iscuri u atmosferu, rashladno sredstvo s nižim potencijalom globalnog zagrevanja (GWP) manje će doprineti globalnom zagrevanju nego rashladno sredstvo sa višim potencijalom globalnog zagrevanja. Ovaj uređaj sadrži rashladnu tečnost sa vrednošću GWP od [675]. To znači da, ako 1 kg ove rashladne tečnosti iscuri u atmosferu, uticaj na globalno zagrevanje će biti [675] puta veći nego da iscuri 1 kg CO₂, posmatrano u periodu od 100 godina. Ne pokušavajte sami da zamenite rashladno sredstvo niti da rasklopite proizvod, već uvek zatražite pomoć stručnjaka.
- 2 Potrošnja energije „XYZ“ kWh godišnje, na osnovu rezultata standardnog testa. Stvarna potrošnja energije zavisi od toga kako se uređaj koristi i gde je smešten.
- 3 Potrošnja energije „XYZ“ kWh godišnje, na osnovu rezultata standardnog testa. Stvarna potrošnja energije zavisi od toga kako se uređaj koristi i gde je smešten."

Troubleshooting

The table below list the self-diagnostic routines. For some of error codes, you must contact an authorized service centre. If an error occurs during the operation, it is displayed on the outdoor unit PCB LED, both MAIN PCB and INVERTER PCB.

| No. | Error Code | Meaning | Remarks |
|-----|------------|--|--|
| 1 | E108 | Error due to duplicated communication address | Check on repeated indoor unit main address |
| 2 | E121 | Error on room temperature sensor of indoor unit (Short or Open) | Indoor unit Room Thermistor Open/Short |
| 3 | E122 | Error on EVA IN sensor of indoor unit (Short or Open) | Indoor unit EVA_IN Thermistor Open/Short |
| 4 | E123 | Error on EVA OUT sensor of indoor unit (Short or Open) | Indoor unit EVA_OUT Thermistor Open/Short |
| 5 | E153 | Error on float switch (2nd detection) | Indoor unit Float Switch Open/Short Drain Pump operation Check |
| 6 | E154 | Indoor fan error | Check on indoor unit indoor Fan operation |
| 7 | E198 | Error on thermal fuse of indoor unit (Open) | Thermal Fuse Open Check of indoor unit Terminal Block |
| 8 | E201 | Communication error between the indoor unit and outdoor unit (Pre-tracking failure or when the actual number of indoor units are different from the indoor unit quantity setting on the outdoor unit) Error due to communication tracking failure after initial power is supplied (The error occurs regardless of the number of units.) | Check indoor quantity setting in outdoor |
| 9 | E202 | Communication error between indoor unit and outdoor unit (When there is no response from indoor units after tracking is completed) | Check electrical connection and setting between indoor unit and outdoor unit |
| 10 | E203 | Communication error between the outdoor unit and main micom (For PF #4 to #6 controllers, error will be determined from the time when the compressor is turned on.) | Check electrical connection and setting between indoor unit MAIN PBA - INVERTER PBA |
| 11 | E221 | Error on outdoor temperature sensor (Short or Open) | Check Outdoor sensor Open / Short |
| 12 | E231 | Error on outdoor COND OUT sensor (Short or Open) | Check Cond-Out sensor Open / Short |
| 13 | E251 | Error on discharge temperature sensor of compressor1 (Short or Open) | Check Discharge sensor Open / Short |
| 14 | E320 | Error on OLP sensor (Short or Open) | Check OLP sensor Open / Short |
| 15 | E403 | Compressor down due to freeze protection control | Check Outdoor Cond. |
| 16 | E404 | System stop due to overload protection control | Check Comp. when it starts |
| 17 | E407 | Comp down due to high pressure | - |
| 18 | E416 | System stop due to discharge temperature | - |
| 19 | E422 | Blockage detected on high pressure pipe | 1. Check if the service valve is open 2. Check for refrigerant leakage (pipe connections, heat exchanger) and charge refrigerant if necessary 3. Check if there's any blockage on the refrigerant cycle (indoor unit/outdoor unit) 4. Check if additional refrigerant has been added after pipe extension |

Appendix

| No. | Error Code | Meaning | Remarks |
|-----|------------|--|--|
| 20 | E440 | Heating operation restricted at outdoor temperature over Theat_high value | HEATING |
| 21 | E441 | Cooling operation restricted at outdoor temperature below Tcool_low value | COOLING |
| 22 | E458 | Fan speed error | FAN1 ERROR |
| 23 | E461 | Error due to operation failure of inverter compressor | - |
| 24 | E462 | System stop due to full current control | - |
| 25 | E463 | Over current trip / PFC over current error | Check OLP sensor |
| 26 | E464 | IPM Over Current(O.C) | IPM |
| 27 | E465 | Comp. Over load error | - |
| 28 | E466 | DC-Link voltage under/over error | Check AC Power and DC Link Voltage |
| 29 | E467 | Error due to abnormal rotation of the compressor or unconnected wire of compressor | Check Comp wire |
| 30 | E468 | Error on current sensor (Short or Open) | Check Outdoor Inverter PBA. |
| 31 | E469 | Error on DC-Link voltage sensor (Short or Open) | - |
| 32 | E470 | Outdoor unit EEPROM Read/Write error (Option) | Check Outdoor EEPROM Data |
| 33 | E471 | Outdoor unit EEPROM Read/Write error (H/W) | Check Outdoor EEPROM PBA |
| 34 | E474 | Error on IPM Heat Sink sensor of inverter1 (Short or Open) | Check Outdoor Inverter PBA. |
| 35 | E483 | Over Voltage Protecting Error | Check Outdoor inverter PBA |
| 36 | E484 | PFC Overload (Over current) Error | Check Outdoor Inverter PBA. |
| 37 | E485 | Error on input current sensor of inverter1 (Short or Open) | Check Outdoor EEPROM PBA |
| 38 | E488 | AC Input Voltage limit Sensor Error | Check Outdoor inverter PBA |
| 39 | E500 | IPM over heat error on inverter1 | Check Outdoor Inverter PBA. |
| 40 | E508 | Smart install is not installed | - |
| 41 | E554 | Gas leak detected | Check the refrigerant |
| 42 | E556 | Error due to mismatching capacity of indoor and outdoor unit | Check the indoor and outdoor unit capacity |
| 43 | E557 | When DPM mode, Product option are not same between indoor units | - |
| 44 | E563 | Error due to mismatching indoor and outdoor unit | Check the outdoor EEPROM data and indoor option code |
| 45 | E590 | Inverter EEPROM Checksum error | - |

Technical specifications

| Model | Net weight (kg) | Net dimension (W × D × H) (mm) |
|-------------|-----------------|--------------------------------|
| AC026RXADKG | 32.5 | 790 × 285 × 548 |
| AC035RXADKG | 32.5 | 790 × 285 × 548 |
| AC052RXADKG | 43.0 | 880 × 310 × 638 |
| AC071RXADKG | 51.0 | 880 × 310 × 798 |

SAMSUNG